VIỆT NAM SOLAR
vietnamsolar.vn

DYNESS



STACK314

USER MANUAL

Battery Module
51.2V/314Ah

File version-20260330-V0-EN information might be subject to change without notice during product improving.

Contents

Statement of Law 1
Revision History 1
Safe handling of lithium batteries guide 2
1 Introduction 4
1.1 Brief Introduction 4
1.2 Product Properties 4
1.3 Product identity definition 5
2 Product specifications 7
2.1 System Performance Parameter 7
2.2 Battery Module 10
2.3 Battery controller 13
3 Installation and Configuration 17
3.1 Environmental Requirements 17
3.2 Installation location precautions 18
3.3 Equipment installation 26
3.4 Expansion package installation 33
3.5 Battery Capacity Description 40
3.6 Electrical installation 41
3.7 App Operation Instruction 46
4 Maintenance 53
4.1 Troubleshooting 53
4.2 Replacement of Main Components 55
4.3 Battery Maintenance 56
5 Storage 57
6 Shipment 57
Annex 1 STACK314 Expansion Pack Usage Guide 58
EU Declaration of Conformity 61

vietnamsolar.vn

Statement of Law

Copyright of this document belongs to Dyness Digital Energy Technology Co., LTD..

No part of this documentation may be excerpted, reproduced, translated, annotated or duplicated in any form or by any means without the prior written authorization of Dyness Digital Energy Technology Co., LTD.All Rights Reserved.

This product complies with the design requirements of environmental protection and personal safety. The storage, use and disposal of the products shall be carried out in accordance with the product manual, relevant contract or relevant laws and regulations.

You can check the related information on the website of Dyness Digital Energy Technology Co., LTD.when the product or technology is updated.

Web URL: http://www.dyness.com/

Please note that the product can be modified without prior notification.

Revision History

Revision No.	Revision Date	Revision Reason
V1.0	2026.03.30	First Published.
V2.0	2026.8.25	Updated the Compatible Inverters column: added Dyness (HT-A Series) inverters.
V3.0	2026.09.02	Updated LAN port description

VIỆT NAM SOLAR
vietnamsolar.vn

Safe handling of lithium batteries guide

DANGER

Before installation or operation you must read the “STACK314 User Manual” carefully.

The batteries will produce high-voltage DC power and might cause lethal voltage and electric shock.

Only qualified persons are allowed to wire the batteries.

WARNING

This product is a high-voltage DC system, and should be operated by authorized persons only.

Risk of battery system damage or personal injury.

DO NOT disconnect while the system is running!

Keep all power sources off and verify that they are de-energized.

Battery damage may result in electrolyte leakage. If the electrolyte is leaked, do not touch the leaked electrolyte or volatile gas, and contact the after-sales service team for help immediately. If leaked material was touched accidentally, please follow the steps below:

- Inhalation of leaked material: Evacuate from the contaminated area and seek medical assistance immediately.
- Eye contact: Flush with clean water for at least 15 minutes and seek medical assistance immediately.
- Skin contact: Wash the contact area thoroughly with soap and clean water and seek medical assistance immediately.
- Ingestion: Induce vomiting and seek immediate medical assistance.
- Do not move the battery system if it is connected to an external expansion module.
- If you need to replace or add a battery, please contact the after-sales service center.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

CAUTION

Risk of battery system failure or life cycle reduction.

Before Connecting

Please check the product and packing list after unpacking. If the product is damaged or parts are missing, please contact the local dealer.

Before installation, make sure that the grid is disconnected and the battery is switched off.

Do not invert the positive and negative cables and ensure there is no short circuit to the external device.

It is prohibited to connect the battery to AC power directly.

The battery system must be properly grounded and the resistance must be less than 1Ω.

Ensure that the electrical parameters of the battery system are compatible with the respective equipment.

Keep the battery away from water and fire.

During Use

If the battery system needs to be moved or repaired, the power must be disconnected and the battery must be switched off.

It is prohibited to connect different types of batteries.

It is prohibited to connect the battery to incompatible or faulty inverters.

It is prohibited to disassemble the battery (to avoid the warranty sticker being removed or damaged).

In case of fire, only a dry powder fire extinguisher must be used, foam extinguishers are prohibited.

Please do not open, repair or disassemble batteries; this is reserved for Dyness staff or authorized personnel. We do not take any responsibility caused by violation of safety operation or equipment safety standards.

Maintenance

Please read the user manual carefully. If batteries are stored for a long time, it is required to charge them every 10~12 months, and the SOC should be no less than 50%.Do not expose cables outside.All battery terminals must be disconnected for maintenance.Please contact the supplier within 24 hours if there is something abnormal.

Warranty claims are excluded for direct or indirect damage due to items above.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

1 Introduction

1.1 Brief Introduction

STACK314 is a high-voltage battery storage system based on lithium iron phosphate batteries, and it is one of the new energy storage products developed and produced by Dyness. It can be used to support reliable power for various types of equipment and systems. STACK314 is especially suitable for application scenes of high power, limited installation space, restricted load-bearing and long cycle life.

1.2 Product Properties

- The entire module is non-toxic, non-polluting and environmentally friendly.
- Anode material is made from $LiFePO_4$ with safety performance and long cycle life.
- The Battery Management System (BMS) comes with protective functions including over-discharge, over-charge, over-current and high/low temperature.
- The system can automatically manage the charge and discharge state and balance the current and voltage of each cell.
- Flexible configuration, multiple battery modules can be connected in series for expanding voltage and capacity.
- 200A discharge, built-in air-cooling system.
- Each PACK has an independent fire extinguishing device.
- The module has less self-consumption, up to 10~12 months without charging; no memory effect, excellent performance of shallow charge and discharge.
- Working temperature range is from -20 to +55°C, with excellent discharge performance and cycle life.
- Small size and lightweight, standard module is easy to install and maintain.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

1.3 Product identity definition

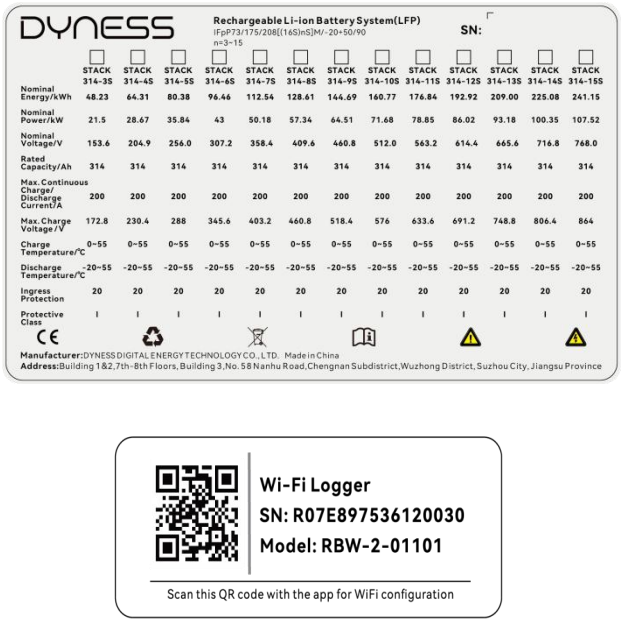


Figure 1-1 Battery energy storage system nameplate and WiFi QR code label

	The battery voltage is higher than the safe voltage, and direct contact results in an electric shock hazard.
	Be careful with your actions and be aware of the dangers.
	Read the user manual before use.
	Do not dispose of the scrapped batteries with household waste; they must be recycled by professional personnel or institutes.
	After the useful life of the battery, it can continue to be used after being recycled by a professional recycling organization.
	This battery meets European directive requirements.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

	Keep away from open flames or other ignition sources.
	Be aware of explosive gas.
	Be aware of battery leakage.
	Heavy objects. Lift with care.
	Keep the battery pack away from children.

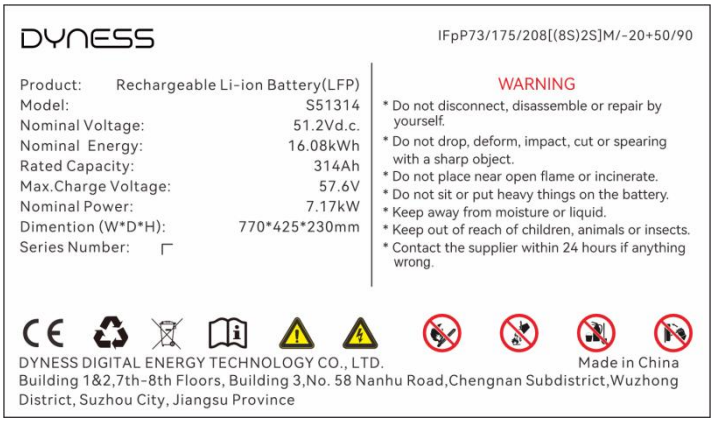


Figure 1-2 Battery module label

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

2 Product specifications

2.1 System Performance Parameter

Table 2-1 Parameters of the STACK314 system

Model	STACK 314-3s	STACK 314-4s	STACK 314-5s	STACK 314-6s	STACK 314-7s
Nominal Voltage/Rated Capacity	51.2V/ 314Ah	51.2V/ 314Ah	51.2V/ 314Ah	51.2V/ 314Ah	51.2V/ 314Ah
System Modules Serial Number	3	4	5	6	7
System Energy Range	48.23 kWh	64.31 kWh	80.38 kWh	96.46 kWh	112.54 kWh
Operating Voltage	134-175V	179-233V	224-292V	268-350V	313-408V
Recommended Charge/Discharge Current	140A	140A	140A	140A	140A
Max.Charge Continuous/Discharge Current	200A	200A	200A	200A	200A
Peak Discharge Current(2min 25℃)	290A	290A	290A	290A	290A
Depth of Discharge	95%	95%	95%	95%	95%
Communication	CAN/ RS485	CAN/ RS485	CAN/ RS485	CAN/ RS485	CAN/ RS485
Cycle Life [1]	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles
Single Module Weight	115Kg	115Kg	115Kg	115Kg	115Kg
Single Cluster Dimension[W*D*H]	770/425/293+230*n				
Charging Temp. Range	0～55℃	0～55℃	0～55℃	0～55℃	0～55℃
Discharging Temp. Range	-20～ 55℃	-20～ 55℃	-20～ 55℃	-20～ 55℃	-20～55℃
Ingress Protection	IP20	IP20	IP20	IP20	IP20
Fire Protection System	Aerosol fire extinguisher				
Installation method	Stack type				
Cooling method	Forced wind cooling				

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

WIFI Module	Built-in WIFI module; APP OTA function				
Certification & Safety Standard	CE¸EMC/CE¸RED/UN38.3				
Compatible Inverters	Dyness、ATESS、Deye、Growatt、Megarevo、Solinteg、Solis、Sosen、Sinexcel etc.				
Model	STACK 314-8s	STACK 314-9s	STACK 314-10s	STACK 314-11s	STACK 314-12s
Nominal Voltage/Rated Capacity	51.2V/ 314Ah	51.2V/ 314Ah	51.2V/ 314Ah	51.2V/ 314Ah	51.2V/ 314Ah
System Modules Serial Number	8	9	10	11	12
System Energy Range	128.61 kWh	144.69 kWh	160.77 kWh	176.84 kWh	192.92 kWh
Operating Voltage	358-467V	403-525V	448-584 V	492-642 V	537-700V
Recommended Charge/Discharge Current	140A	140A	140A	140A	140A
Max.Charge Continuous/Discharge Current	200A	200A	200A	200A	200A
Peak Discharge Current(2min 25℃)	290A	290A	290A	290A	290A
Depth of Discharge	95%	95%	95%	95%	95%
Communication	CAN/ RS485	CAN/ RS485	CAN/ RS485	CAN/ RS485	CAN/ RS485
Cycle Life [1]	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles
Single Module Weight	115Kg	115Kg	115Kg	115Kg	115Kg
Single Cluster Dimension[W*D*H]	770/425/293+230*n				
Charging Temp. Range	0～55℃	0～55℃	0～55℃	0～55℃	0～55℃
Discharging Temp. Range	-20～ 55℃	-20～ 55℃	-20～ 55℃	-20～ 55℃	-20～55℃
Ingress Protection	IP20	IP20	IP20	IP20	IP20
Fire Protection System	Aerosol fire extinguisher				
Installation method	Stack type				

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Cooling method	Forced wind cooling
WIFI Module	Built-in WIFI module; APP OTA function
Certification & Safety Standard	CE،EMC/CE،RED/UN38.3
Compatible Inverters	Dyness、ATESS、Deye、Growatt、Megarevo、Solinteg、Solis、Sosen、Sinexcel etc.

Model	STACK 314-13s	STACK 314-14s	STACK 314-15s
Nominal Voltage/Rated Capacity	51.2V/314Ah	51.2V/314Ah	51.2V/314Ah
System Modules Serial Number	13	14	15
System Energy Range	209.00kWh	225.08kWh	241.15kWh
Operating Voltage	582-759V	627-818V	672-876V
Recommended Charge/Discharge Current	140A	140A	140A
Max.Charge Continuous/Discharge Current	200A	200A	200A
Peak Discharge Current(2min 25℃)	290A	290A	290A
Depth of Discharge	95%	95%	95%
Communication	CAN/ RS485	CAN/ RS485	CAN/ RS485
Cycle Life [1]	⩾8000 cycles	⩾8000 cycles	⩾8000 cycles
Single Module Weight	115Kg	115Kg	115Kg
Single Cluster Dimension[W*D*H]	770/425/293+230*n		
Charging Temp. Range	0～55℃	0～55℃	0～55℃
Discharging Temp. Range	-20～55℃	-20～55℃	-20～55℃
Ingress Protection	IP20	IP20	IP20
Fire Protection System	Aerosol fire extinguisher		
Installation method	Stack type		

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Model	STACK 314-13s	STACK 314-14s	STACK 314-15s
Cooling method	Forced wind cooling		
WIFI Module	Built-in WIFI module; APP OTA function		
Certification & Safety Standard	CE、EMC/CE、RED/UN38.3		
Compatible Inverters	Dyness、ATESS、Deye、Growatt、Megarevo、Solinteg、Solis、Sosen、Sinexcel etc.		

[1] Test conditions: 0.2C Charging/Discharging, @25℃, 95% DOD

[2] Height of Expansion Upper Cover: 80mm,."n" stands for the number of battery modules, up to a maximum of 8. If the installation is on an upper floor, you will need to evaluate the floor weighing before determining the number of stacks.

2.2 Battery Module

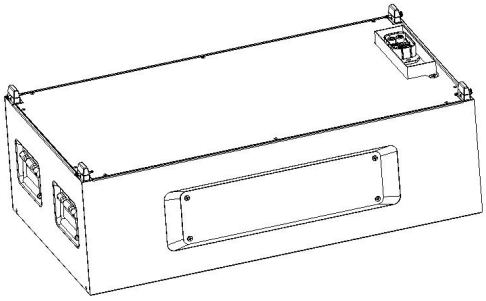


Figure 2-1 Battery module

Table 2-2 Product parameters

Module name	S51314
Cell technology	Li-ion (LFP)
Battery module capacity (kWh)	16.08
Battery module voltage (V/DC)	51.2
Battery module capacity (Ah)	314
Number of battery module cells (pcs)	16
Battery cell capacity (Wh)	1004.8
Battery cell voltage (V/DC)	3.2
Battery cell capacity (Ah)	314
Dimensions (W*D*H, mm)	770*425*230.5
Pollution degree (PD)	II

© Dyness reserves the copyright of this document.

vietnamsolar.vn

Module name	S51314
Ambient temperature (°C)	0 to +55
Ingress Protection	IP20
Weight (kg)	115

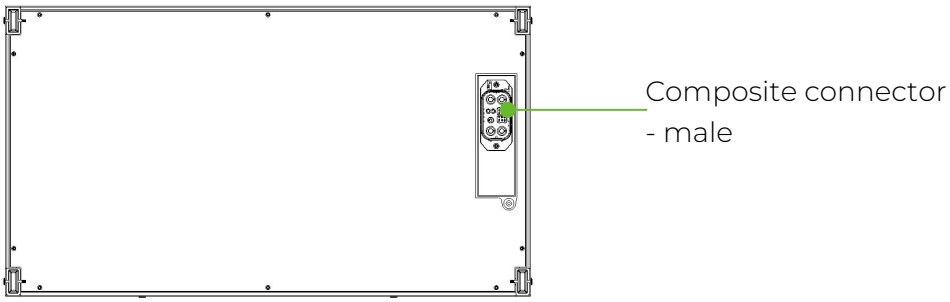


Figure 2-3 S51314 top connector

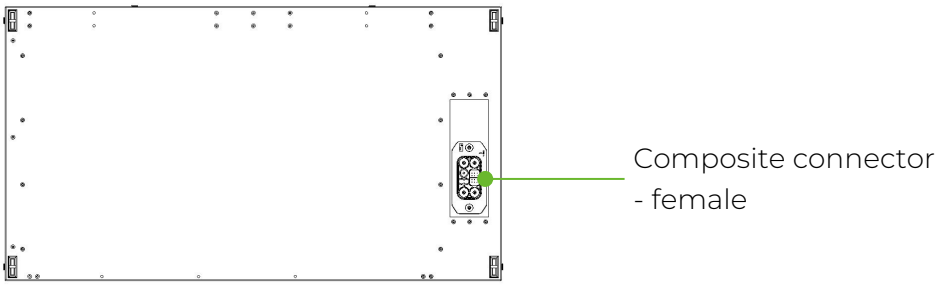


Figure 2-4 S51314 bottom connector

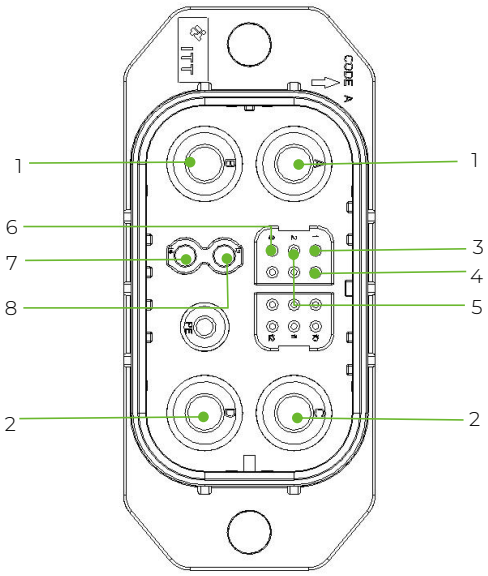


Figure 2- 5 Composite connector - male

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

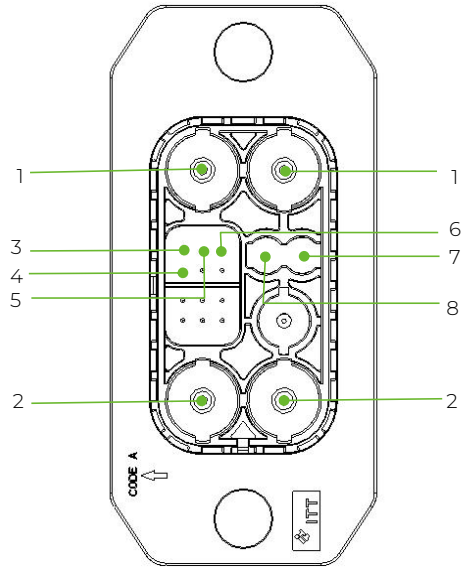


Figure 2-6 Composite connector - female

Table 2-3 Connector definition

Item	Name	Definition
1	Composite connector - male	Battery module output and communication interface
2	Composite connector - female	Battery module output and communication interface

Table 2-4 Port definition

No.	Composite connector - male	Composite connector - female
1	Positive output	Negative output
2	Negative output	Module negative
3	IMA (BMU Communication)	IMA (BMU Communication)
4	IPC (BMU Communication)	IPC (BMU Communication)
5	IPA (BMU Communication)	IPA (BMU Communication)
6	IMC (BMU Communication)	IMC (BMU Communication)
7	24V-	24V-
8	24V+	24V+

© Dyness reserves the copyright of this document.

vietnamsolar.vn

2.3 Battery controller

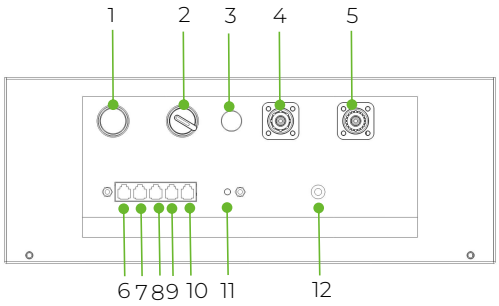


Figure 2-7 BDU right connector

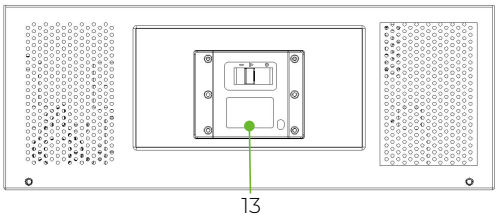


Figure 2-8 BDU left connector

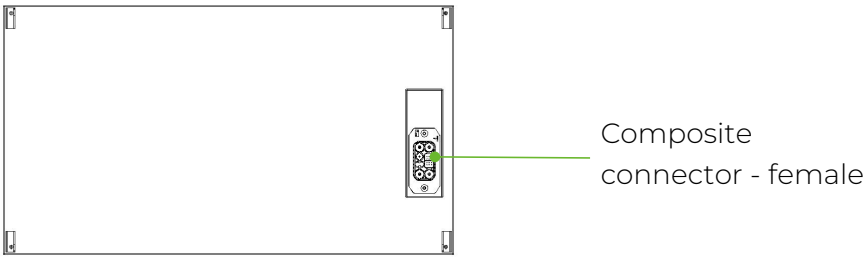


Figure 2-9 BDU bottom connector

Table 2-5 Connector definition

Item	Name	Definition
1	Power Wake Button	Long press this button to start the battery system
2	Power On switch	Turn on the switch to power the BMS system
3	WiFi antenna	Receiving and sending WiFi signals
4	External negative female	Connect battery system to inverter negative terminal
5	External positive socket	Connect battery system to inverter positive terminal
6	LAN	Reserved for communication with certain high-power inverters.
7	Inverter CAN/RS485	RJ45 communication port between battery system and inverter
8	Inverter CAN/RS485	RJ45 communication port between battery system and inverter

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Item	Name	Definition
9	Parallel in	Parallel communication connection of multi cluster systems
10	Parallel out	Parallel communication connection of multi cluster systems
11	WiFi antenna	Receiving and sending WiFi signals
12	Grounding	Shell ground connection
13	DC breaker	The master switch of the battery system, you must switch it on before switching on the Power On and Power WAKE switches; short circuit protection

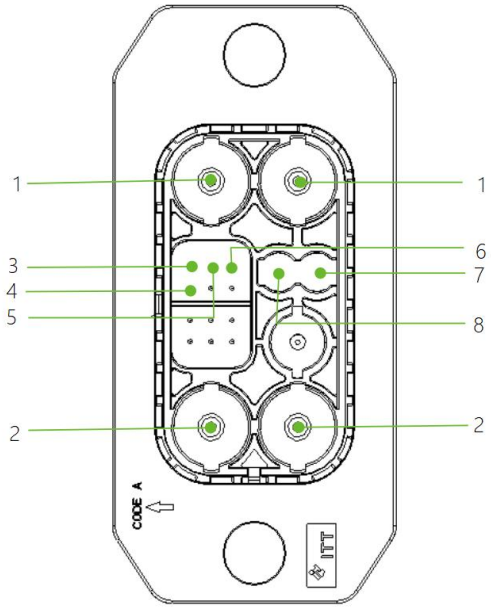


Figure 2-10 Power On switch

Table 2-6 Port definition

No.	Definition
1	Positive output
2	Negative output
3	IMA (BMU Communication)
4	IPC (BMU Communication)
5	IPA (BMU Communication)
6	IMC (BMU Communication)
7	24V-
8	24V+

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

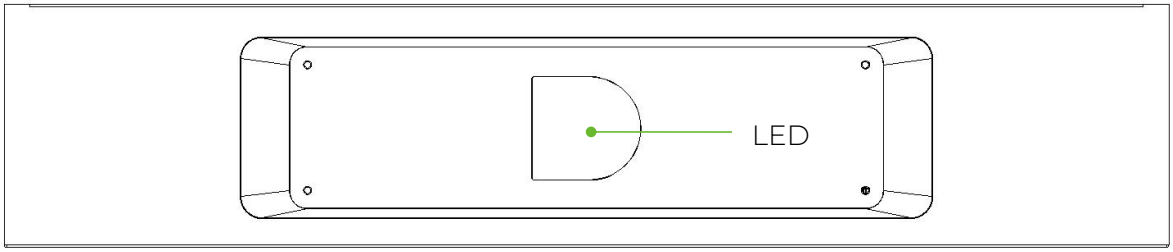


Figure 2-11 BDU front view

Table 2-7 LED status indicators

LED status	Information
	SOC 50%
	SOC 100%
Current SOC increases to 100% ,then cycles 	Charge
Drop from current SOC to 0%, then loop 	Discharge
Green light flashing(Current SOC) 	Standby
Yellow light flashing	Communication failure between batteries or communication failure between lamp board and BMS
Red light on 	System protection

DANGER

Ensure ON/OFF switch is turned on before waking up the battery. Otherwise it will affect the auto test process and cause danger.

DO NOT switch off the ON/OFF switch during normal operation, only in

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

emergencies. Otherwise it will cause the battery current to surge.

CAUTION

If the DC breaker trips because of over-current or short circuit, you must wait for 30 minutes to switch it on again, otherwise it may cause damage to the breaker.

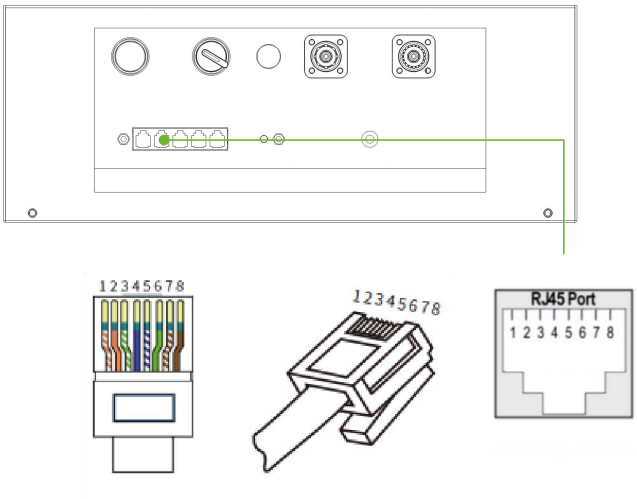


Figure 2-12 “Inverter CAN/RS485” port pins

Table 2-8 Definition of “Inverter CAN/RS485” port pins

PIN	Color	Definition
PIN1	Orange/White	485_B
PIN2	Orange	485_A
PIN3	Green/White	Reserved
PIN4	Blue	CANH
PIN5	Blue/White	CANL
PIN6	Green	NC
PIN7	Brown/White	NC
PIN8	Brown	NC

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

3 Installation and Configuration

3.1 Environmental Requirements

Working temperature: -20°C~+55°C.

Charging temperature range: 0°C~+55°C.

Note: When selecting a heating film, the charging temperature range is -20°C~+55°C.

Discharging temperature range: -20°C~+55°C.

Storage temperature: -10°C~+35°C.

Relative humidity: 5% ~ 85%RH.

Elevation: no more than 4000m .

Operating environment: Indoor or outdoor installation, sites avoid the sunlight and no wind, no conductive dust and corrosive gas.

DANGER

Cleanliness

The battery system has high voltage connectors. The environmental conditions will affect the isolation of the system.

Before installation and switch-on, dust and swarf must be removed to keep the system clean. The environment must be dust-proof to a certain extent.

Dust and humidity must be regularly checked during continuous operation of the system.

Fire Protection System

The room must be equipped with a fire protection system or fire extinguishers (Recommended: dry powder fire extinguishers). The fire protection system needs to be regularly checked to ensure its normal condition. Please refer to your local fire protection equipment for use and maintenance requirements.

Grounding System

Make sure that the grounding point for the battery system is stable and reliable before installation. If the battery system is installed in an independent equipment cabin (e.g. container), ensure that the grounding of the cabin is stable and reliable.

The resistance of the grounding system must be ≤100mΩ.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

CAUTION

Temperature

STACK314 system working temperature range: -20°C to +55°C; Optimum temperature: 18°C to 30°C; Exceeding the working temperature range will cause over-temperature/under-temperature alarms or protection of the battery system which may lead to the reduction of cycle lives.

Cooling System

It is essential to equip a cooling system to keep the battery system in a relevant temperature range. Over-temperature/under-temperature alarms or protection of the battery system may lead to the reduction of lifespan.

Heating System

It is essential to equip a heating system to keep the battery system in a relevant temperature range. If the environment is lower than 0°C, the system may be shut down for protection. It is necessary to open the heating system first. Exceeding the working temperature range will cause the battery system over-temperature/under-temperature alarm or protection of the battery system may lead to the reduction of cycle lives.


3.2 Installation location precautions

DANGER

Please note that the battery should be installed with a minimum safe clearance from the surrounding equipment or battery. Please refer to the minimum clearance diagram below.

© Dyness reserves the copyright of this document.

vietnamsolar.vn

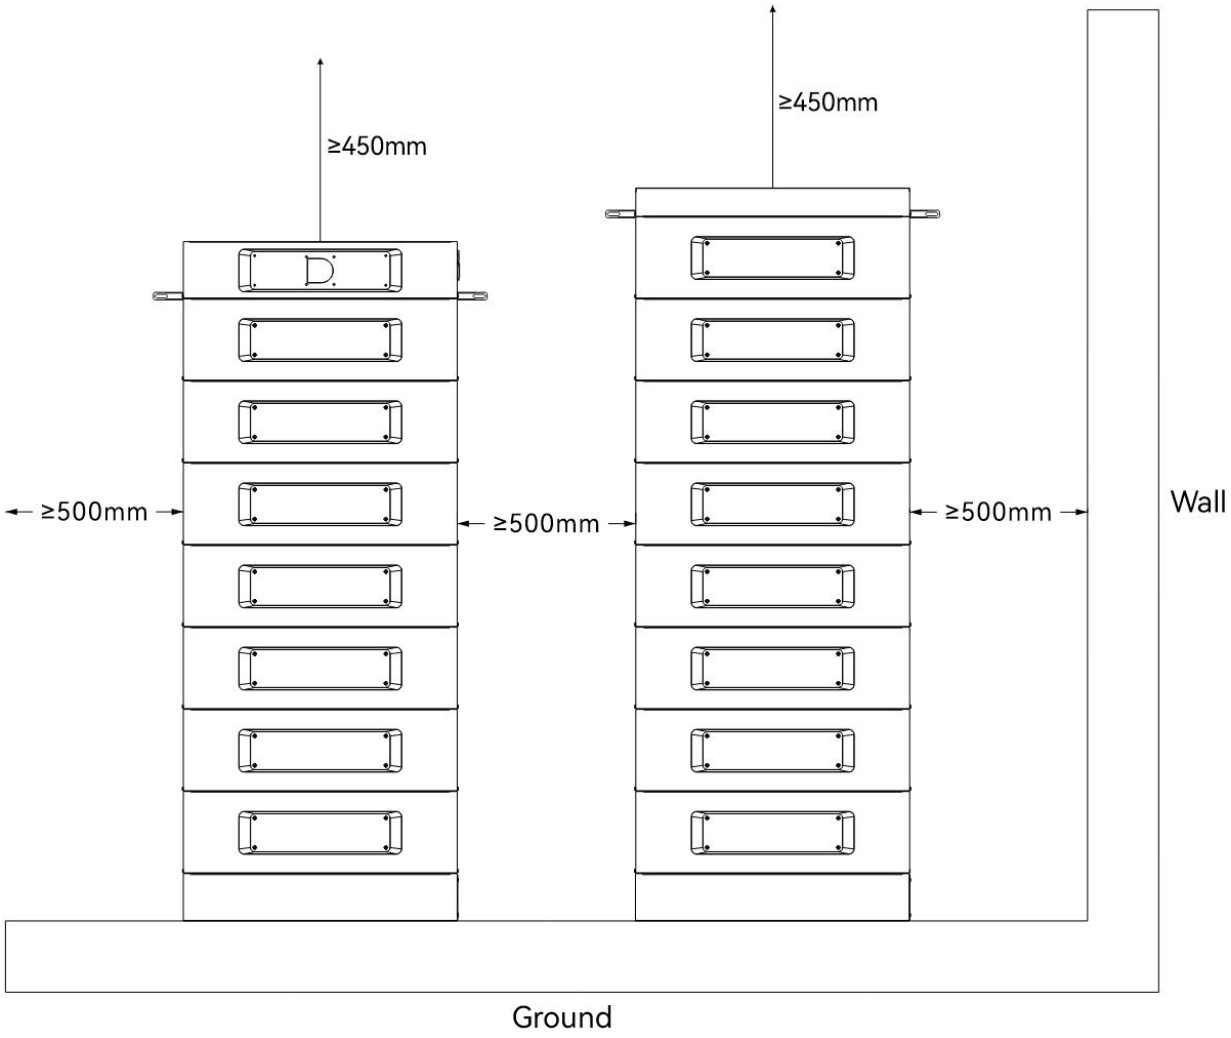

© Dyness reserves the copyright of this document.

vietnamsolar.vn

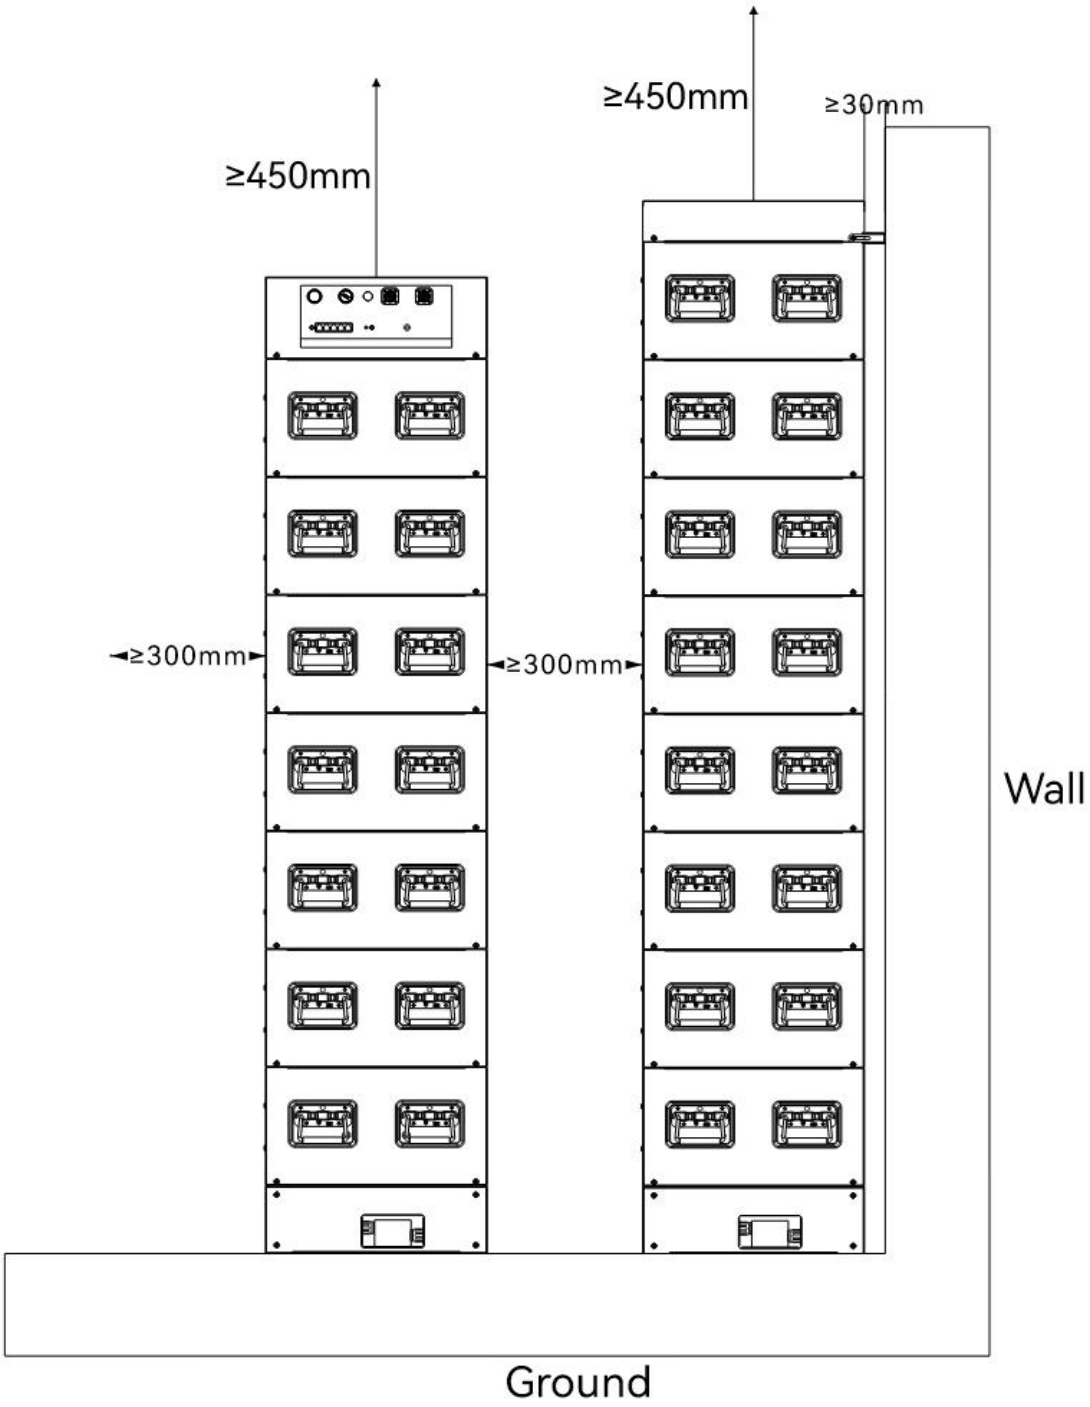


Figure 3-1 Minimum clearance

© Dyness reserves the copyright of this document.

vietnamsolar.vn

Note:

1. The system should be installed with the help of at least 2 grown-up males.
2. If more than 8 of the mare to be configured, It is suggested to divide into two columns. The battery system should be installed indoors, away from flammable and explosive materials.

Tools

The following tools are required to install the battery pack:

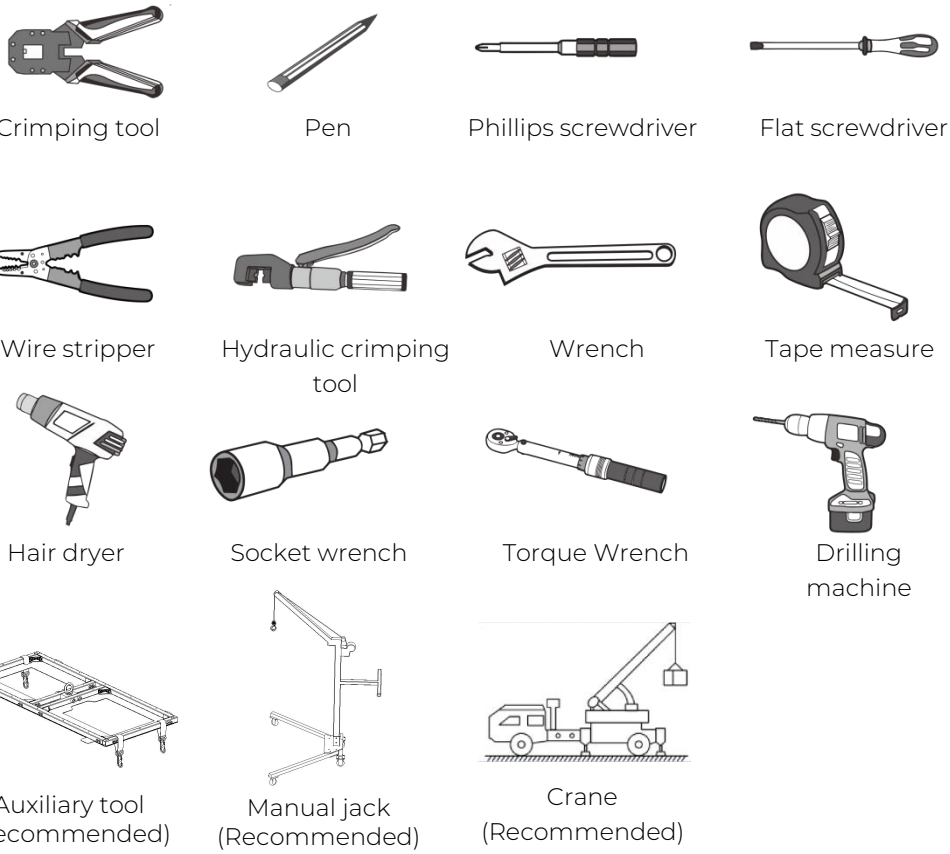


Figure 3-3 Installation tools

Safety Gear

We recommend wearing the following safety gear when working with batteries:

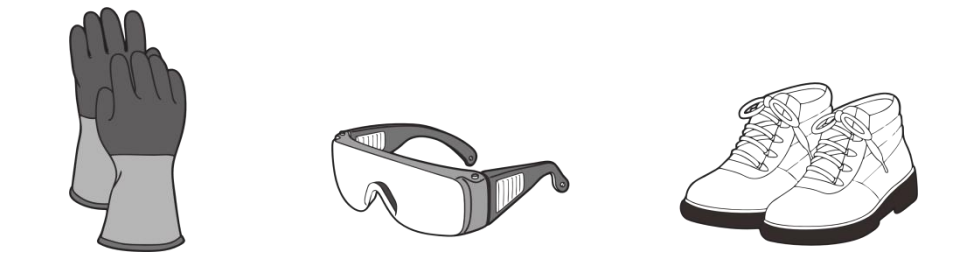


Figure 3-4 Safety gear

© Dyness reserves the copyright of this document.




VIỆT NAM SOLAR
vietnamsolar.vn

Unpacking inspection

- When the equipment arrives at the installation site, unloading should be performed according to rules and regulations, to prevent from being exposed to direct sunlight. The battery should not be installed in direct sunlight. Please refer to Section 3.3
- Before unpacking, the total number of packages shall be indicated according to the shipping list attached to each package, and all packages shall be checked for good condition.
- Handle with care and protect the surface coating of the goods.
- Upon opening the package, the installation personnel should read the technical documentation, verify the list according to configuration table and packing list and ensure that the goods are complete and intact. If the internal packing is damaged, goods should be examined and recorded in detail.




Check the components of the STACK314 Battery System in different capacities

Table 3-1 Scope of delivery

Package	Name	Specifications	Quantity	Image
A	BDU	770*425*230mm	1	
	Base	770*425*133mm	1	
	Fixing bracket	To secure with the wall	2	
	Expansion Bolt	M6*80	2	
	Expansion Bolt	M12*100	4	






© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Package	Name	Specifications	Quantity	Image
	CAN resistor	RJ45-CAN-120, Pin4&5	1	
	Flat head Phillips screws	M5*30	4	
	Terminal	OT4-6	2	
	Communication cable to inverter	b/L2000mm/RJ45 plug at both sides, CAN	1	
	Communication cable to inverter	b/L2000mm/RJ45 plug at both sides, RS485	1	
	Power cable-negative	Positive cable, UL10269 50mm² , red, 2050mm	1	
	Power cable-positive	Negative cable,UL10269 50mm² , black, 2050mm	1	
	Warranty Card	\	1	
	Letter to customer	\	1	



© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

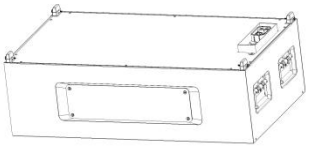Package	Name	Specifications	Quantity	Image
	Packing list	\	1	
	Quick Installation Guide	\	1	
B	S51314	770*425*230mm	1	
	Flat head Phillips screws	M5*30	4	
	Packing list	\	1	
C (optional)	ExpansionBase	770*425*133mm	1	
	Expansion Cover	770*425*80mm	1	
	Flat head Phillips screws	M5*30	4	
	OT terminal	OT4-6	2	
	Communication parallel	Communication between two Column	1	

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Package	Name	Specifications	Quantity	Image
	cable			
	Series cable	Two Columns in series UL10269 50mm²	2	
	Fixing bracket	fix to the wall	2	
	Expansion Bolt	M6*80	2	
	Expansion Bolt	M12*100	4	
	Packing list	\	1	
	Expansion Label	\	1	

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Table 3-2 Scope of delivery

Model	Battery system capacity	Configuration
STACK314-3S	48.23kWh	A+B*3
STACK314-4S	64.31kWh	A+B*4
STACK314-5S	80.38kWh	A+B*5
STACK314-6S	96.46kWh	A+B*6
STACK314-7S	1112.54kWh	A+B*7
STACK314-8S	128.61kWh	A+B*8
STACK314-9S	144.69kWh	A+B*9+C（two columns）
STACK314-10S	160.77kWh	A+B*10+C（two columns）
STACK314-11S	1176.84kWh	A+B*11+C（two columns）
STACK314-12S	192.92kWh	A+B*12+C（two columns）
STACK314-13S	209.00kWh	A+B*13+C（two columns）
STACK314-14S	225.08kWh	A+B*14+C（two columns）
STACK314-15S	241.45kWh	A+B*15+C（two columns）

3.3 Equipment installation

Note:

1. If more than 8 battery modules are to be installed,you are advised to install them in two columns.
2. One battery column (8 Battery + 1 BDU) is about 2208 mm in height. Please maintain a clearance of 450mm above the CM. Namely, ensure that the distance between the floor and the ceiling is greater than 2658 mm for the convenience of installation and better heat dissipation.If the height is not enough,you are advised to install them in two columns,.
3. The system should be installed with the help of at least 2 grown-up males.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

4. .If the use of a conduit is required, please install the bushing to the reserved hole before installing the expansion screw.
5. If the installation is on an upper floor, you will need to evaluate the floor weighing before determining the number of stacks.
6. It is recommended to use a cran during installation.

Installation Preparation

1. Make sure that the environment meets all technical requirements.
2. Prepare equipment and tools for installation.
3. Confirm that the DC breaker is in the OFF position.

Mechanical Installation


DANGER

The battery system is a high-voltage DC system. Ensure that installation area of STACK314 is stable and reliable.
Please confirm that the battery system is switched off before connecting.
Electric shock and damage to the inverter may be caused if the battery is connected directly without being switched off.
Otherwise, the system cannot work properly. The voltage of the battery is too high, please pay attention to self-protection during measurement.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Step 1: Install the battery base.

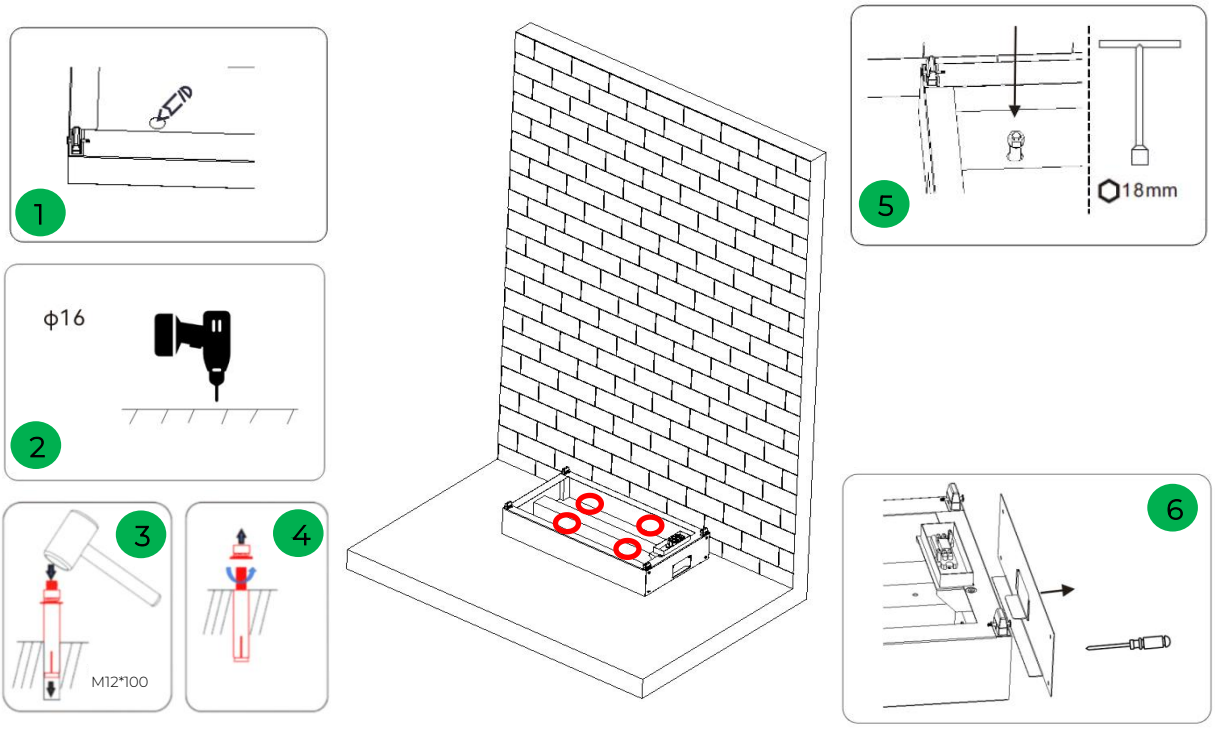

1.Mark the hole positions using a marker.

2.Drill holes at the marked positons to a depth of 95 mm.

3.Knock the expansion screws into the holes(M12x100)

4.Remove the flat washer, the spring washer and the nut.Place the base on the selected position, then install the flat washer, the spring was her and the nut.

5.Tighten the nut to secure the base.


6.When installing in two columns, you need to remove the cover on the side of the base and install the communication line and power line between two columns.

© Dyness reserves the copyright of this document.

vietnamsolar.vn

Step 2:Fix the auxiliary tooling and the battery.

(When stacking 1~5, it can be carried by two adult men without auxiliary tooling.When stacking more than 5 layers, it is recommended to use auxiliary tools.)

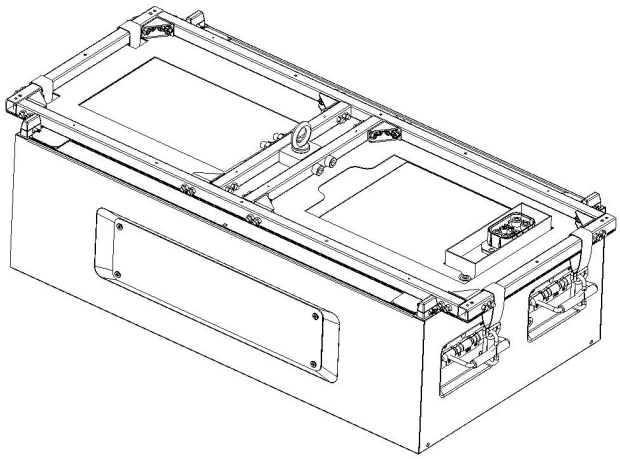


Step 2: Place the Battery Module onto the base, ensuring that the locating pins of the Battery with the locating points on the base.

(When stacking 1~5, it can be carried by two adult men without auxiliary tooling.When stacking more than 5 layers, it is recommended to use auxiliary tools.)

© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn

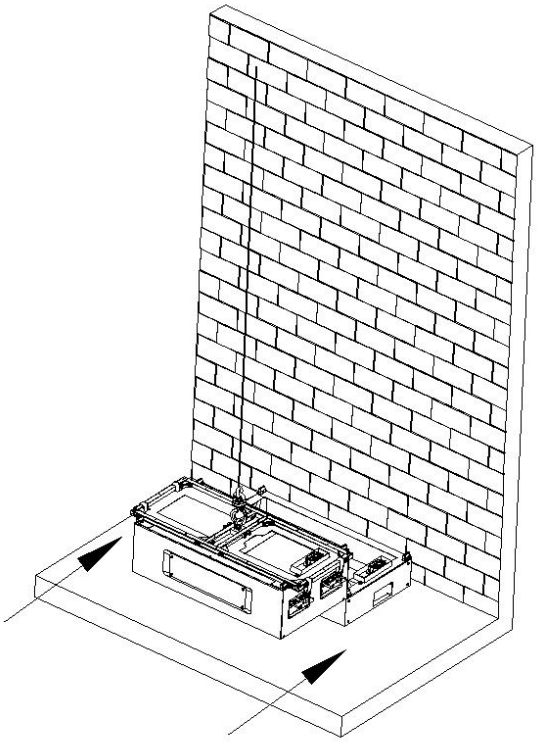


© Dyness reserves the copyright of this document.


vietnamsolar.vn

Step 3: Install four M5*30 locking screws on the left and right sides.



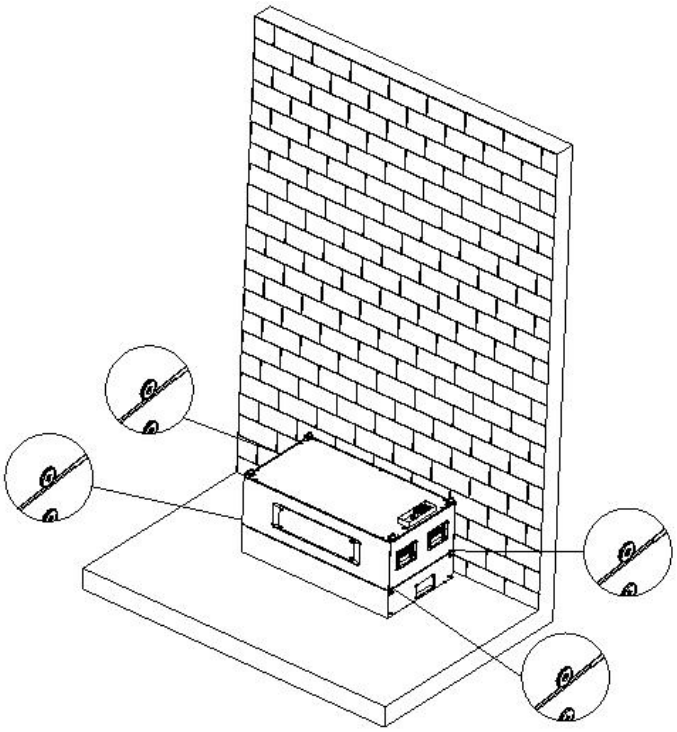


Step 4: Repeat steps 2 and 3 until the required batteries and BDU are installed.

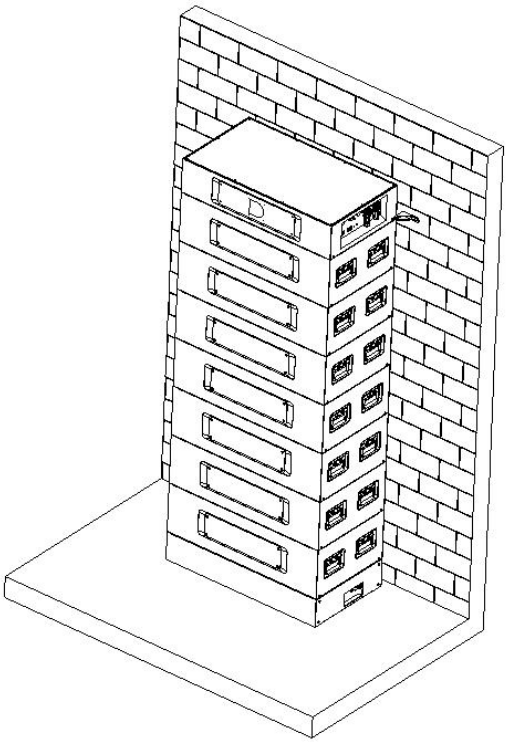

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Step 5: Installed hanging ear.

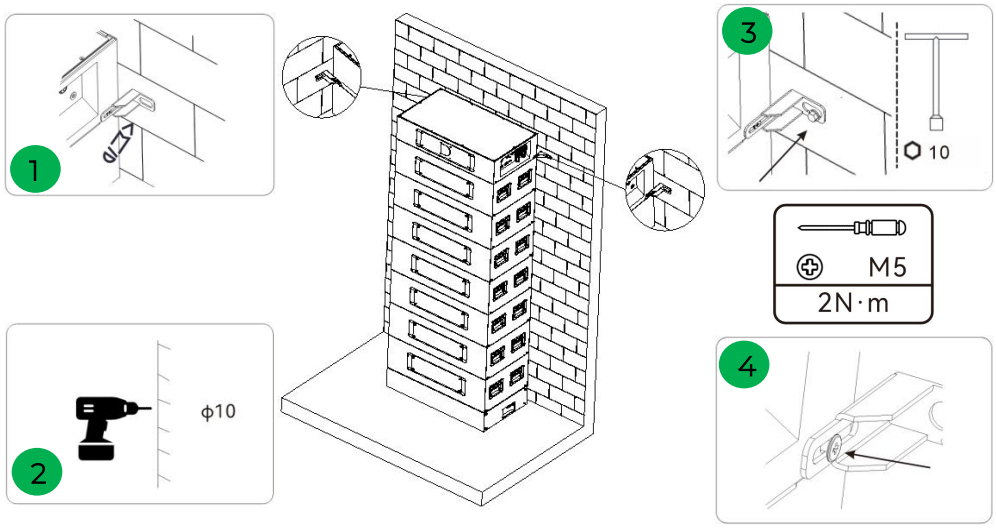

1.Mark the hole positions using a marker.

2.Drill holes at the marked positions to a depth of 90 mm.

3.Hanging ears are installed on the left and right sides respectively and locked to the wall with expansion screws(M6x80).

4.Use two M5*30 screws to fix the left and right Hanging ears to the chassis respectively.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

3.4 Expansion package installation

TIPS

1. If the number of battery packs in a single Column is greater than8, it is recommended to use an expansion pack for installation.
2. After expansion, the standard base becomes an expansion base, and the yellow label needs to be pasted by the customer himself.
3. The operation guide for changing the standard base to an expanded base is attached in Annex 1.


Install according to the minimum distance in Figure 3-1

DANGER







The Extended cover must be exclusively used with the expansion-labeled base. Stacking with standard Base units is prohibited to prevent circuit interruption.

TIPS

The following illustrations depict the correct and incorrect connection methods.

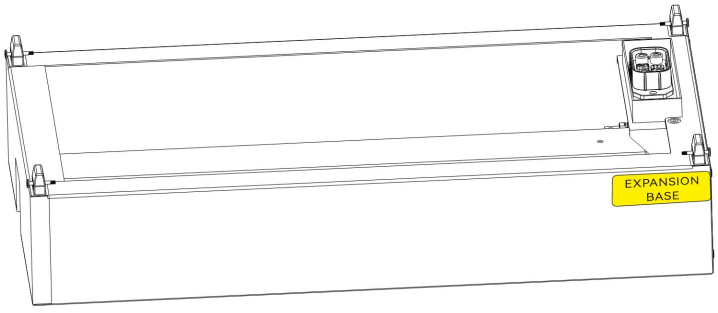


© Dyness reserves the copyright of this document.

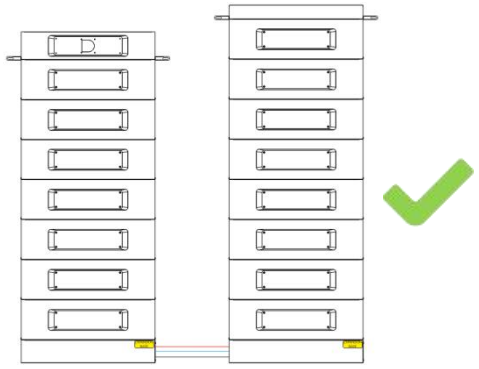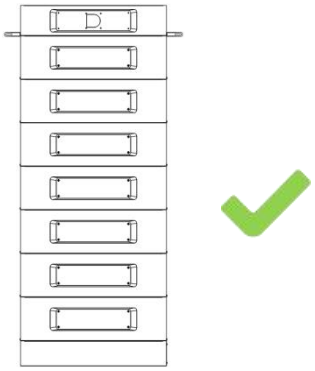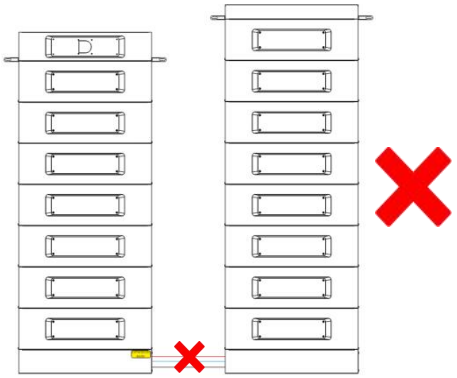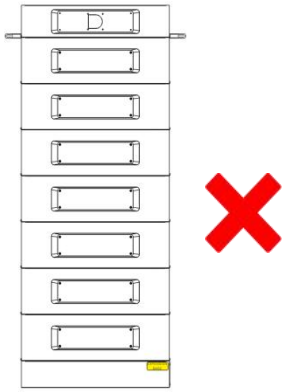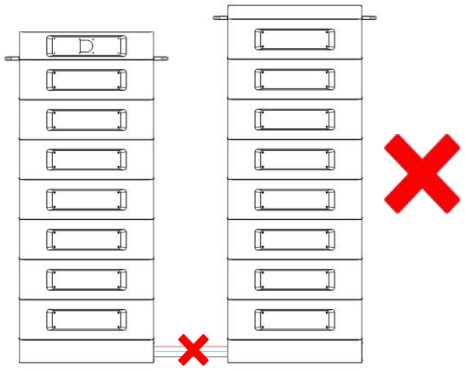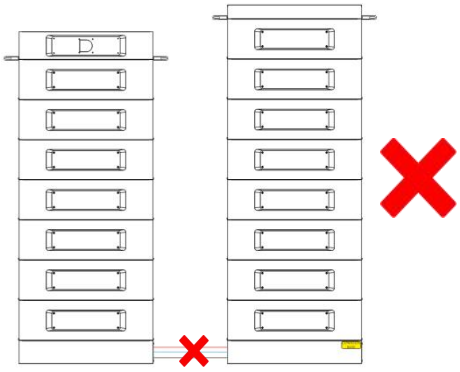Expansion cover in conjunction with Expansion Base		
Expansion covers are prohibited from being used with standard bases.		
		

© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn

Step 1: Use a Screwdriver to unscrew the right cover of the left and right rows of bases.

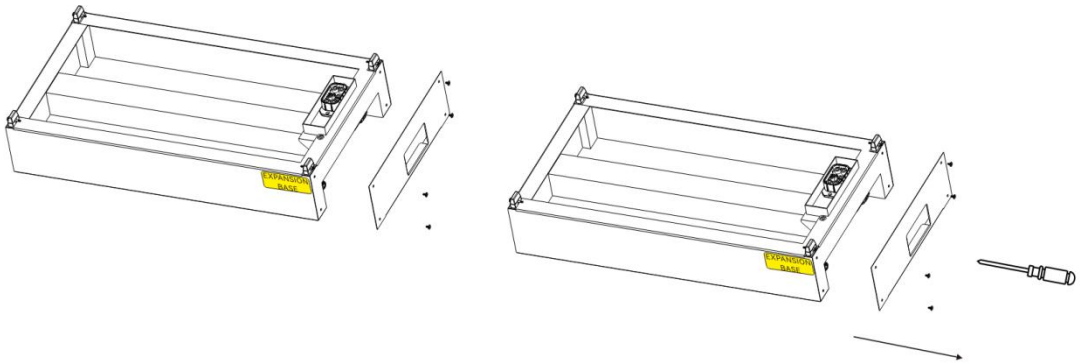

Step 2: Install three cables.


1. Thread the base side cover of the BDU column through the left end of the cable.
2. Pass the right end of the cable through the groove under the expansion package and connect it to the corresponding positive and negative poles and communication ports.

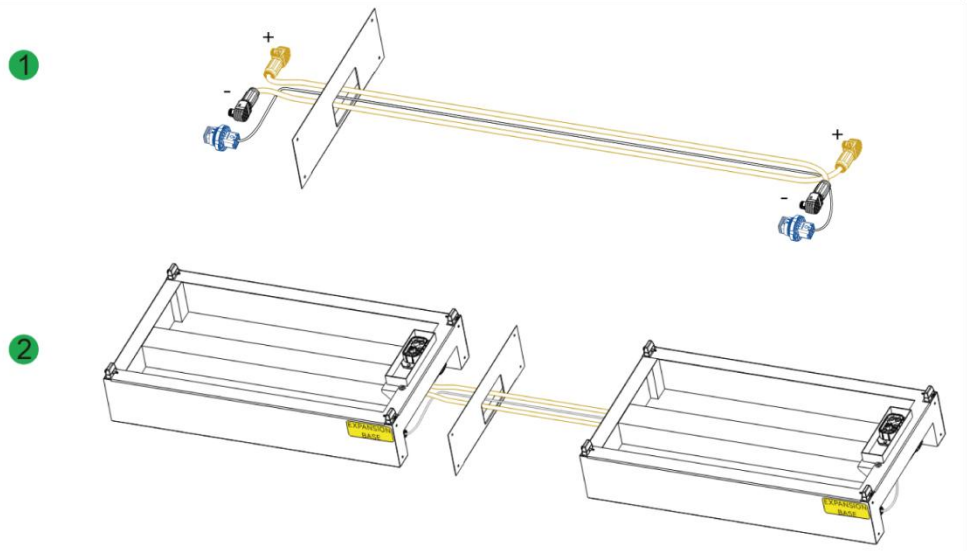


© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


Wiring details:

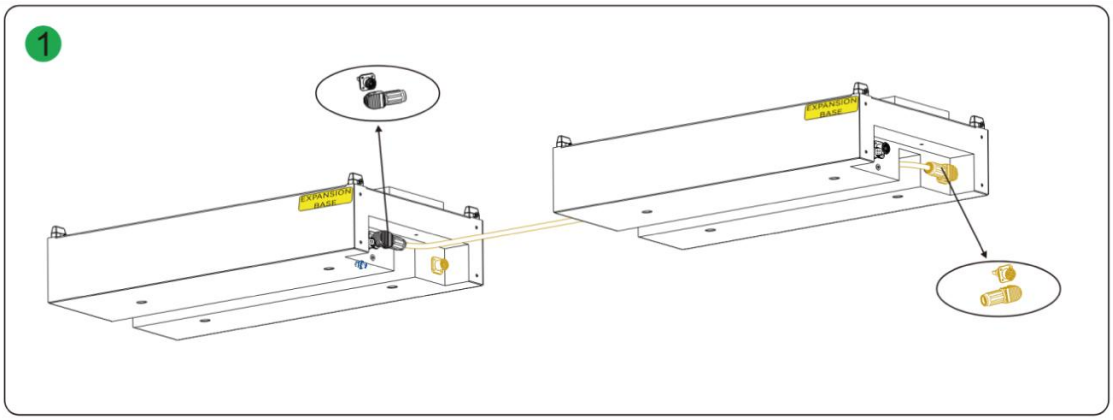

The negative connector of the power line is connected to the negative interface of the main column base.

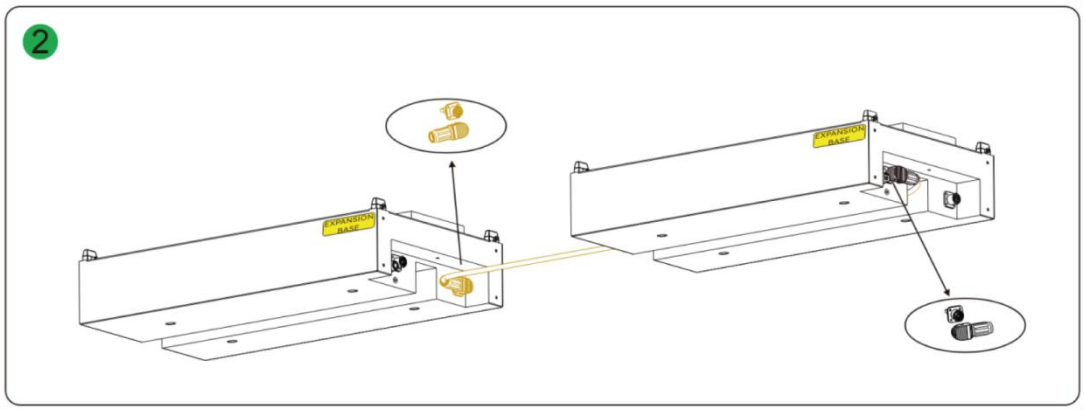

The positive connector of the power line connects the positive interface of the expansion column base.

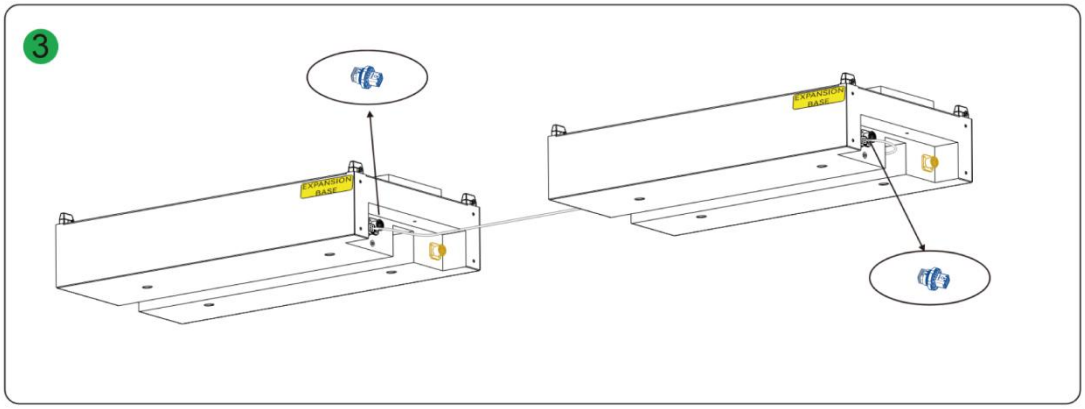

The left end of the communication line is connected to the communication port of the main column, and the right end is connected to the communication port of the expansion column.

© Dyness reserves the copyright of this document.

vietnamsolar.vn


Step 3: Install the battery module according to the above installation steps.



© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


Step 4: Press the "Wake Up" button on the BDU to start up and check if the installation is successful.

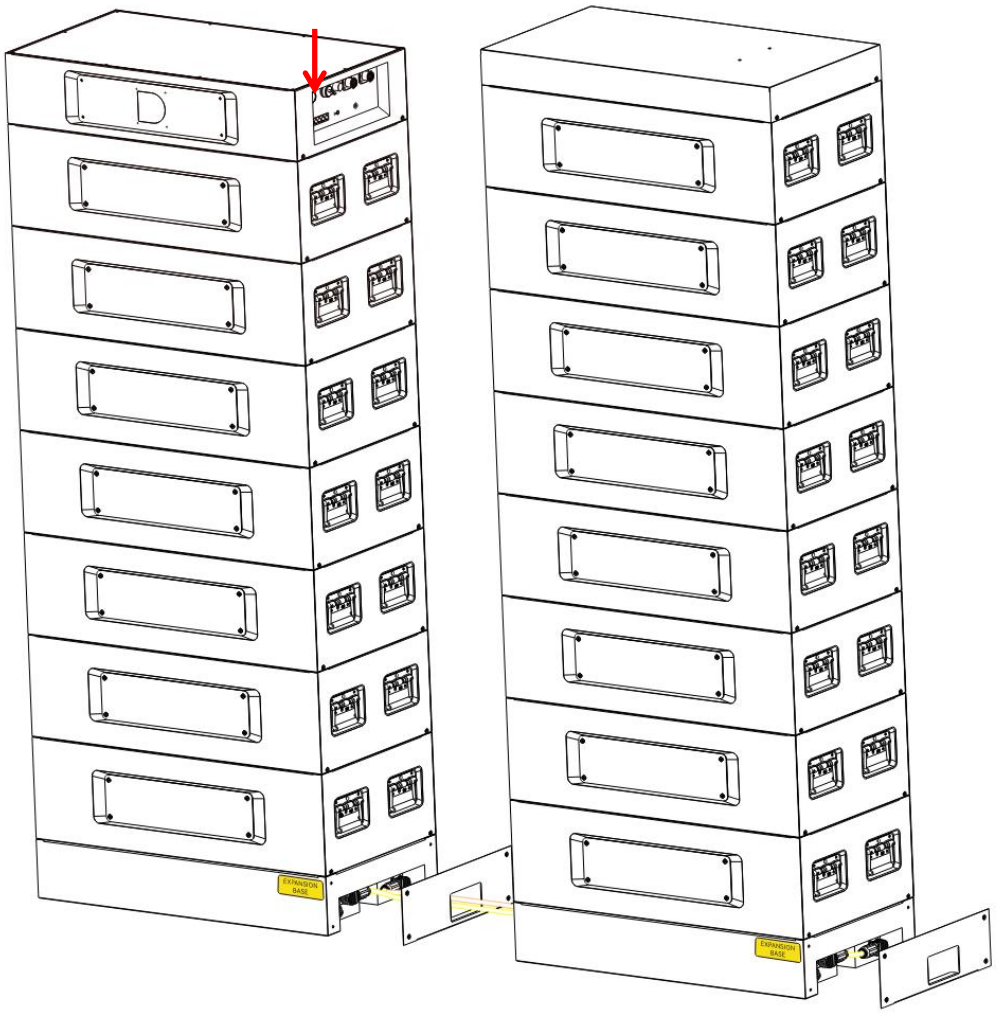

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Step 5: After checking the circuit, lock the right cover of the two column bases separately.

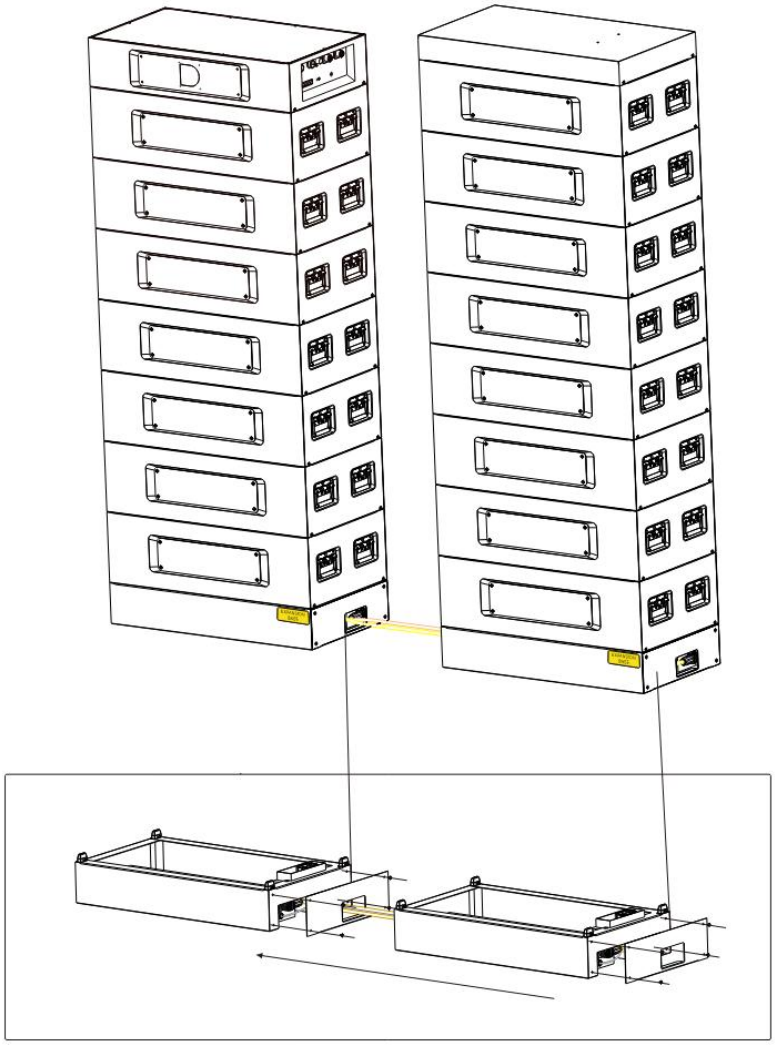

DANGER

The battery system is a high-voltage DC system. Ensure that installation area of STACK314 is stable and reliable.


Please confirm that the battery system is switched off before connecting. Electric shock and damage to the inverter may be caused if the battery is connected directly without being switched off.


Otherwise, the system cannot work properly. The voltage of the battery is too high, please pay attention to self-protection during measurement.


© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn

3.5 Battery Capacity Description

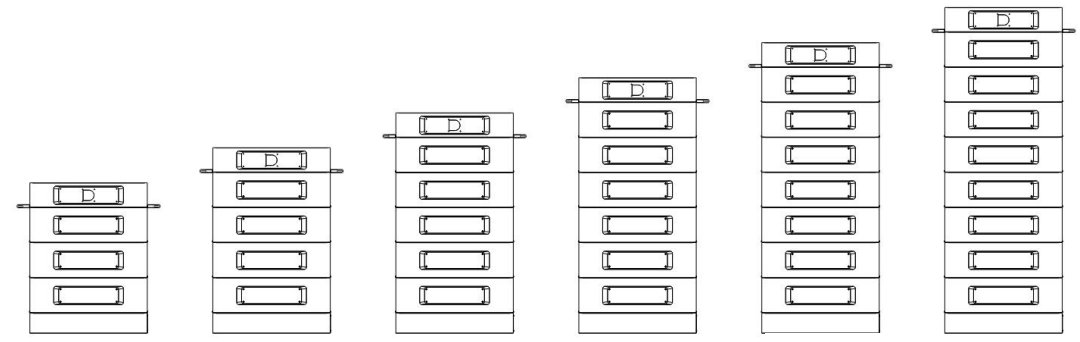

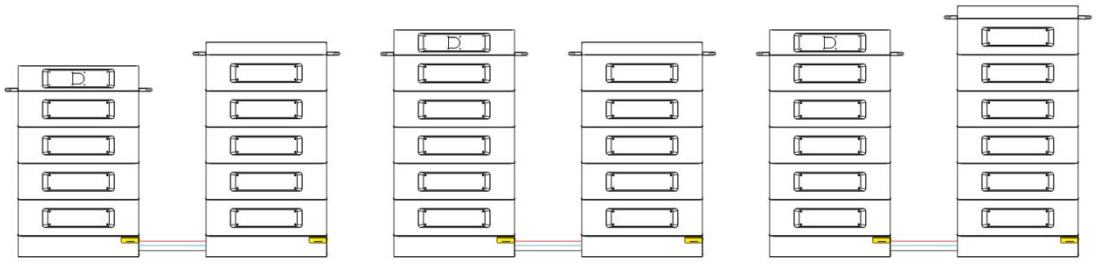

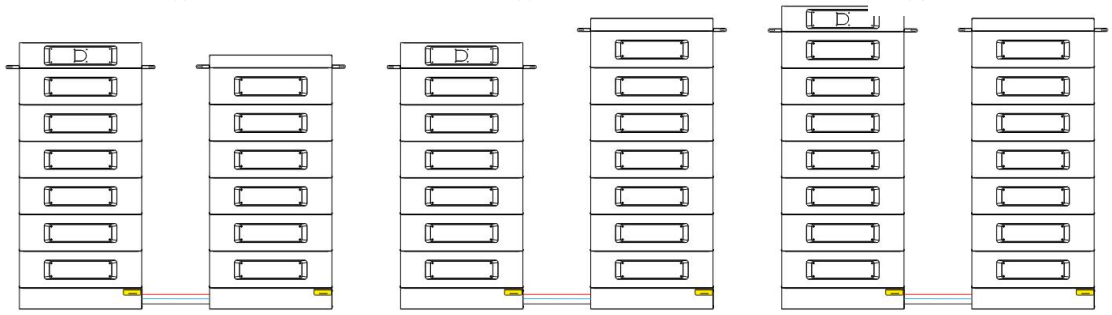

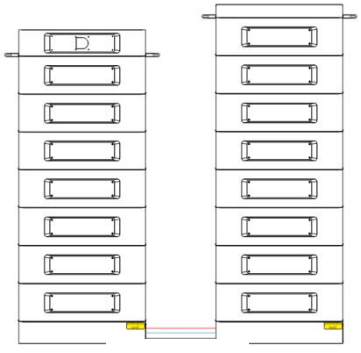

Note:

When configuring the Battery Modules in two columns, please purchase two bases and the extension cables for series connection, which include the power cable, the communication cable .

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


3.6 Electrical installation

CAUTION

Please use the supplied communication cable as the first priority and ensure a secure and reliable connection. Do not extend or modify the communication cable without authorization. If the supplied cable is not compatible or is insufficient in length, please contact us for the compatible cable specifications. The cable shall then be fabricated by a certified electrician using proper tools.

Step 1 Electrical installation

After the system installation is completed. There is a touch down point at the top of the BDU, as shown in the figure below:

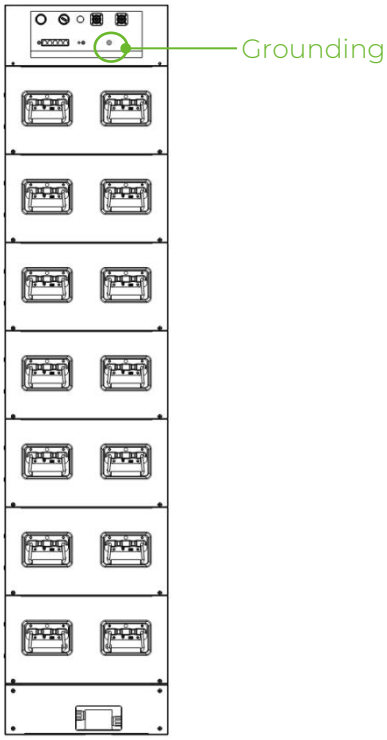


Step 2 Battery system self-test

1. Switch the DC breaker of the BDU on.


© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


Step 2 Battery system self-test

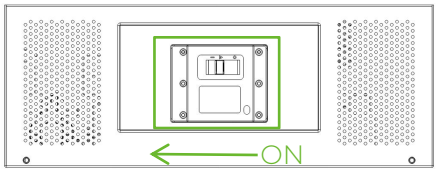

2. Turn the POWER ON knob to ON.

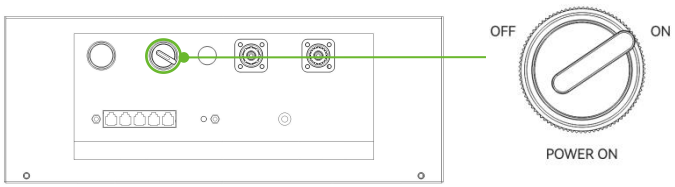


3. Press and hold the WAKE button for approx 15s, battery power on.

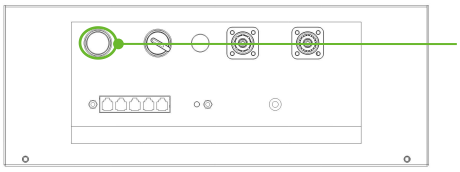


4. Check the system output voltage.

- Use a multimeter to measure the output voltage on the positive and negative ports of the BDU.
- The output voltage should conform to the Operating Voltage range in Table “P7 Table 2-1 Parameter of the STACK314 system”.

5. Turn the POWER ON knob to OFF, battery shutdown.

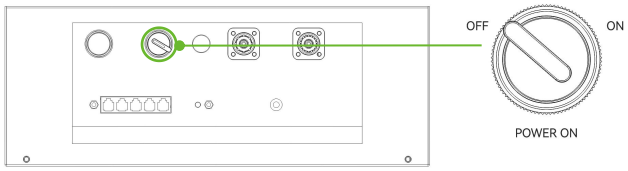


6. Switch the BDU DC BREAKER to OFF position.

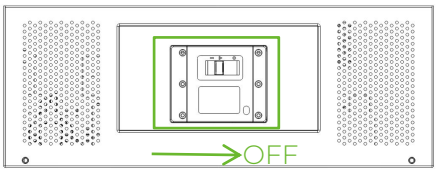

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Step 3 Connecting inverter

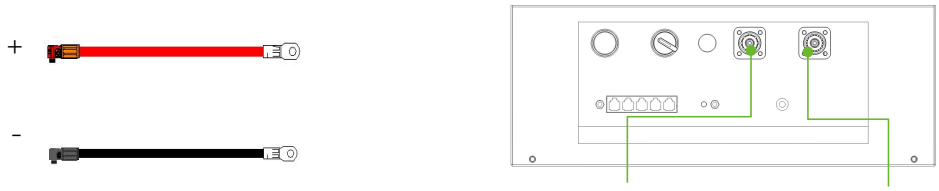


1. Connect the external power cable to the inverter

If the 2m power cable is not long enough, please find another power cable of the same specification.

There are two sizes of communication cable to connect the inverter, one is cable labeled with RS485; one is cable labeled with CAN, matching Soils/GDW/Solinteg/Growatt/Sosen/Deye/SINENG/ATESS/SINEXCEL/Megarevo , please use them differently.

2. Connect the Inverter CAN/RS485 communication cable to the inverter RJ45 CAN/RS485 port.

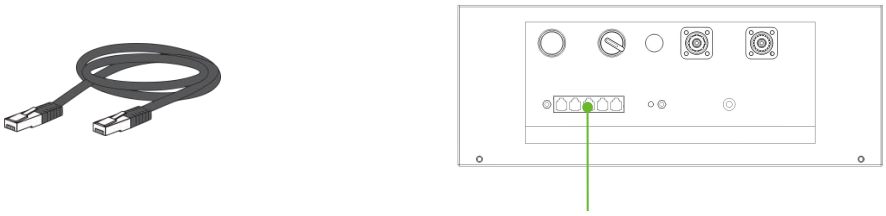

Step 4 Parallel system

Important:

The parallel connection of the STACK314series and all other related work are only allowed by professional and qualified electricians.

The total voltage difference between clusters is less than 20V; SOC of each cluster should be 100% and time interval between newly added cluster and existing cluster should be less than 3 years.

Maximum 12 STACK314clusters are allowed to be connected in parallel.

For parallel operation, the communication cable can only be used with the CAN cable label.

1. Parallel wiring

The general configuration diagram of the STACK314 in parallel connection is as under.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

Step 4 Parallel system

Take three clusters for example:

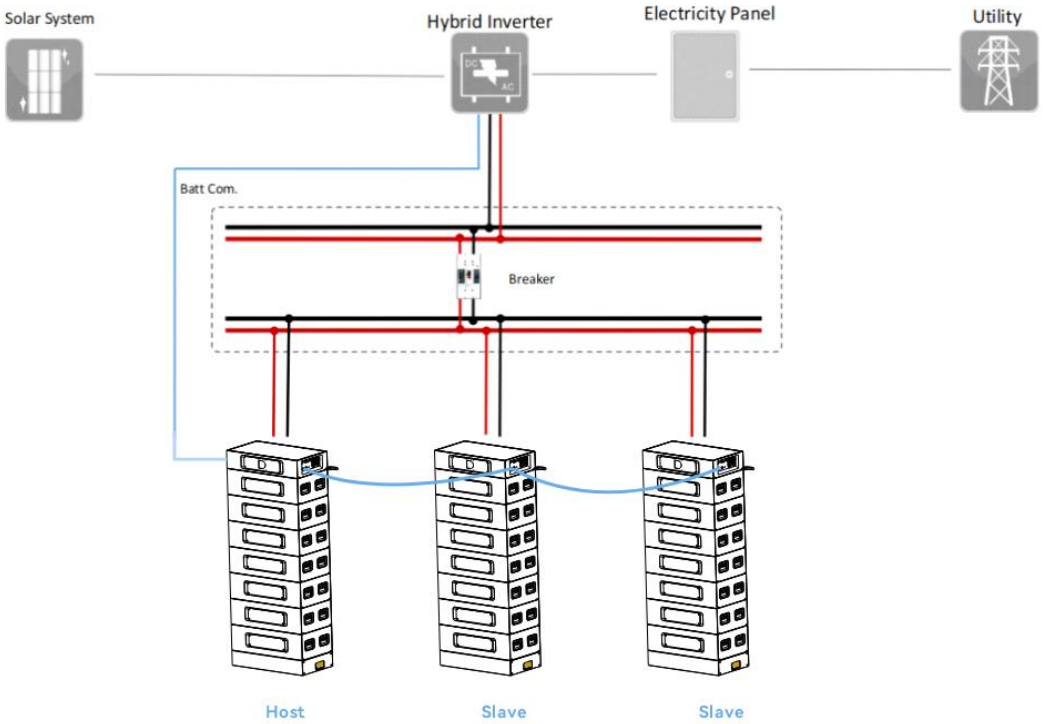


Figure 5-1 The general configuration diagram of the STACK314


© Dyness reserves the copyright of this document.

vietnamsolar.vn


Step 4 Parallel system

Communication network cable connection between STACK314 and STACK314: standard network cable

For multi cluster parallel systems, the communication line connection between clusters is Host's Parallel 2 to the second cluster's(Slave) Parallel 1 and so on.Then connect a 120 Ω CAN resistor to the port of the host parallel 1 and the last slave parallel 2. Ensure the stability of CAN communication.

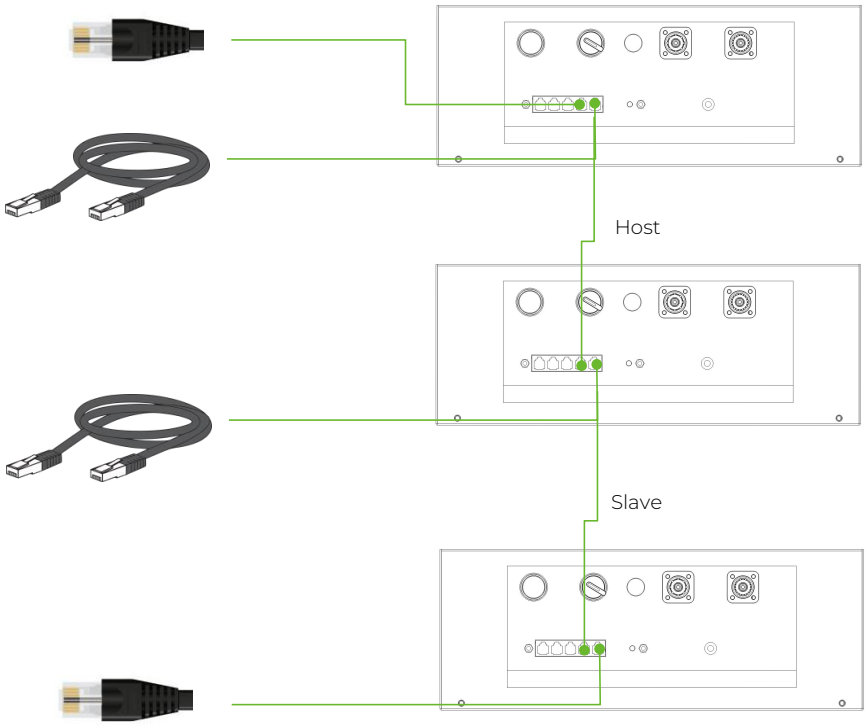

Communication network cable connection between inverter and STACK314(Host):

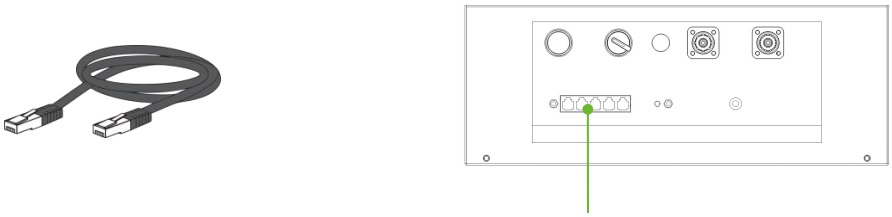

CAN/RS485 of the BDU of STACK314 to the communication port of the inverter. Connect to the inverter RJ45 CAN/RS485 communication port

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


Step 4 Parallel system

Attention

- The STACK314 in parallel must be of the same model and same capacity.
- During capacity expansion, make sure SOC of each module is 100%.
- Power on sequence of multiple clusters: Start the Slave first, then start the Host last.

3.7 App Operation Instruction

- Download the 'Dyness' App to get full functionality of your battery from the App Store (iOS devices) or Google Play(Android devices) or scan below QR code.

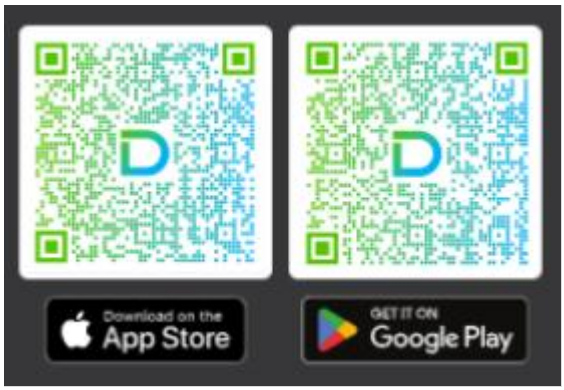

NOTE

- Please upgrade the APP to the latest version.
- Due to APP version updates, the APP interface may differ. Images are for reference only.

- Registration & Login

Register after the APP is installed, click "Create an account", enter the registration page as below:

(1) Select "Create an account" on the Dyness App login interface.

(2) Select the current country or region.

(3) Select the identity "user type" for registering the account,Owner or Partner;


© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn


If you are a partner of Dyness, you can contact the platform business to obtain your exclusive invitation code to complete account registration.


(4) Click "Next"


(5) Follow the prompts on the "Create Account" interface to complete the account registration process.

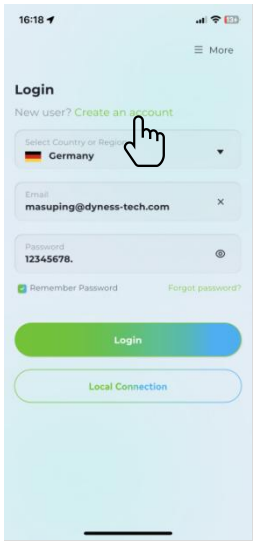


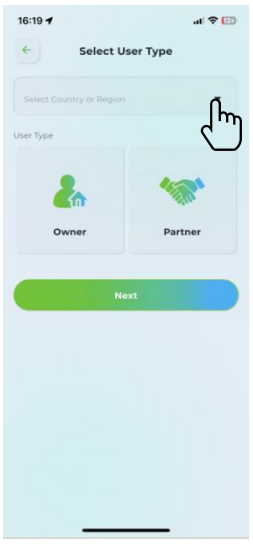


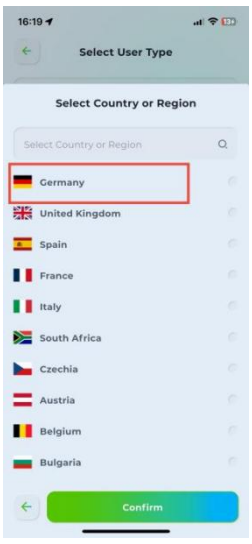


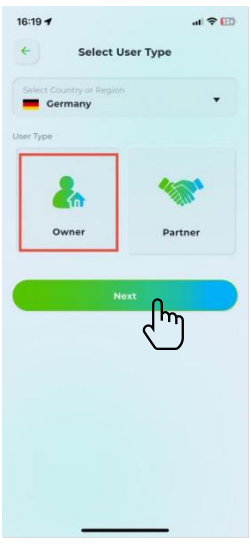

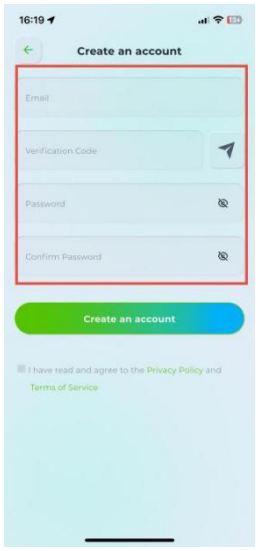

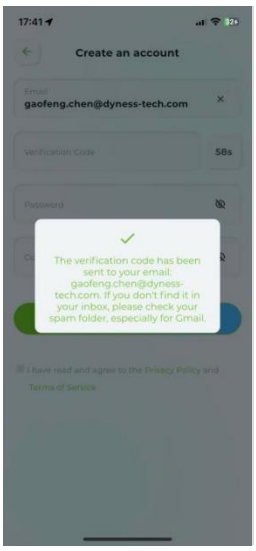

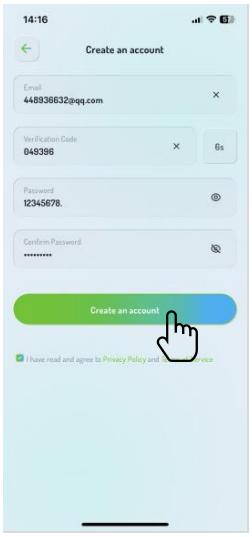

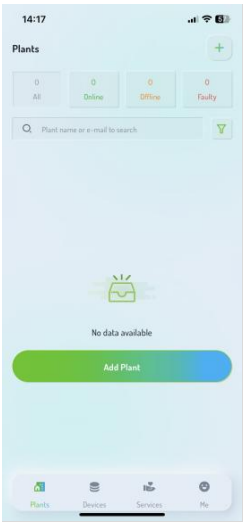

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

- Create Plants,Add Device and Connect the network

Please login account and Create Plant.
Click "Add Plant" to enter the device selection interface, and select the corresponding device type and model.

There are three Methods to add Device:
Method1 :Add via Bluetooth
a. Ensure that the phone is connected to WIFI and Bluetooth is turned on.
b. Bluetooth will automatically scan attachment devices for result display.
c. Select the device to be connected and click on the device name.


Method 2: Add by scanning. This method supports devices with QR codes. If you do not have a QR code, please choose another method
a. Click on 'Scan'.
b. Align the device QR code with the mobile phone scan focus, and the results will be displayed in a list.
c. Select the device to be connected based on the result list, and click on the device name.

Method 3: Add by entering SN [If only one device is connected at a time, this method is recommended]
a. Click on 'Enter SN'.
b. Enter the device SN code.
c. After entering the device SN code, click "Next".

After adding, enter the distribution network,Enter WiFi account and password, Click "Start Provisioning".

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

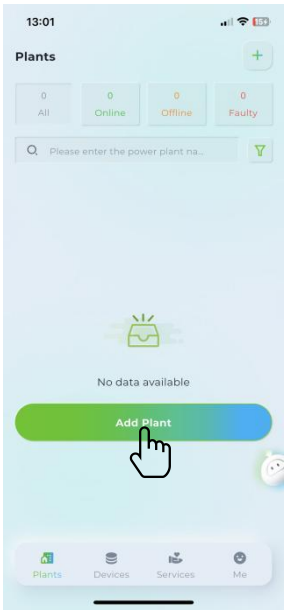






© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

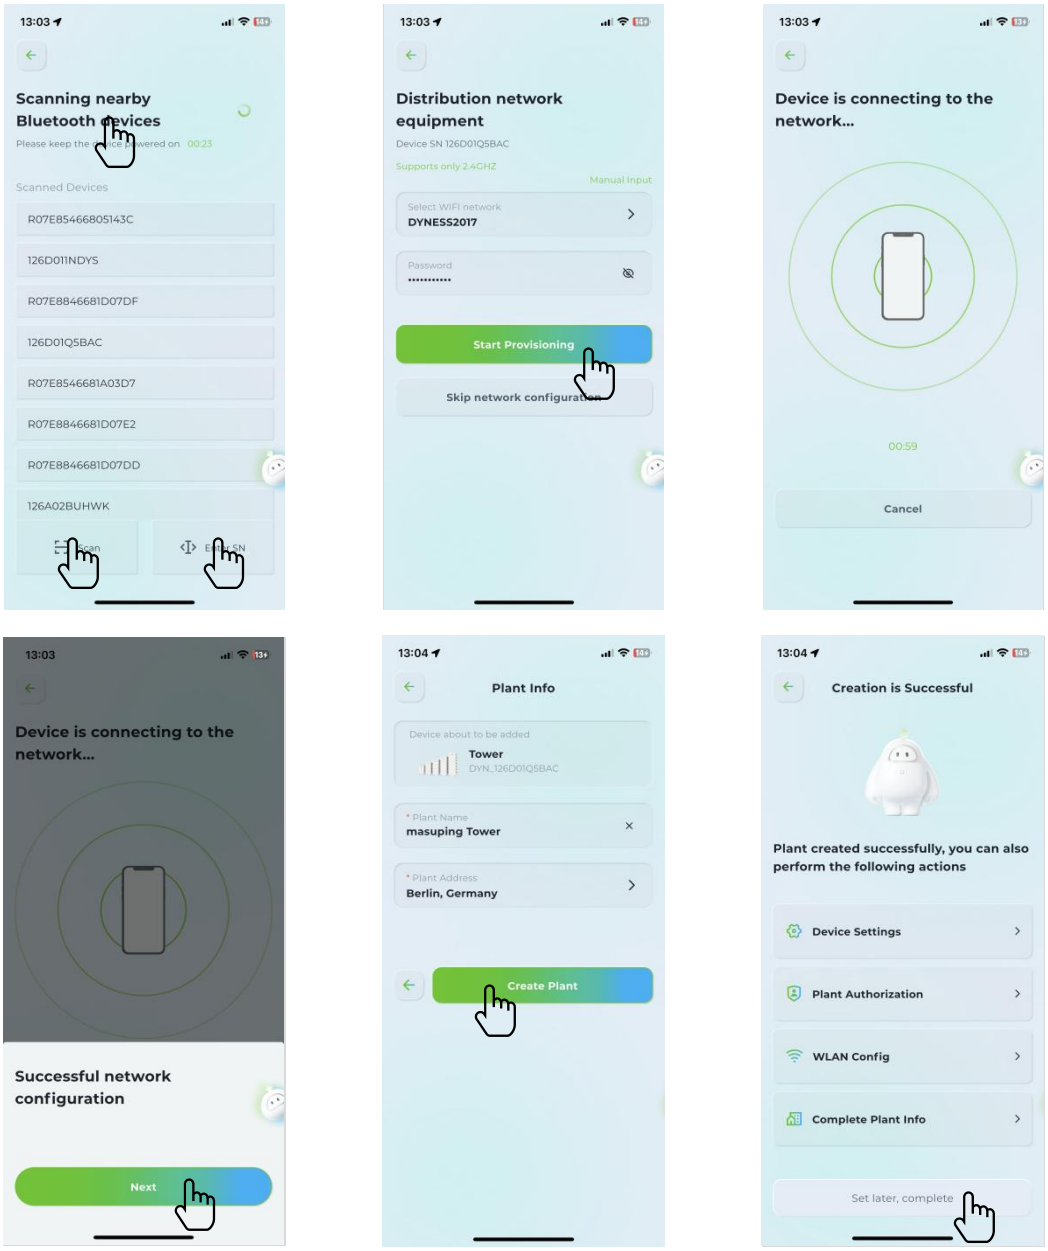



- View battery information


After successful network configuration，wait for 5~10 minutes, Click “Plants”. The default display of device real-time data is detailed, BMS information and historical data and basic information can be viewed by switching tabs

© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn

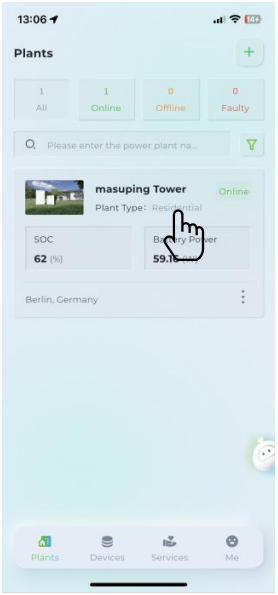


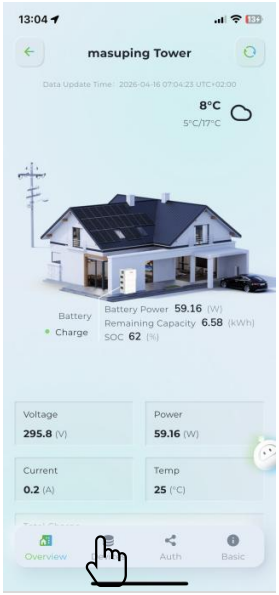


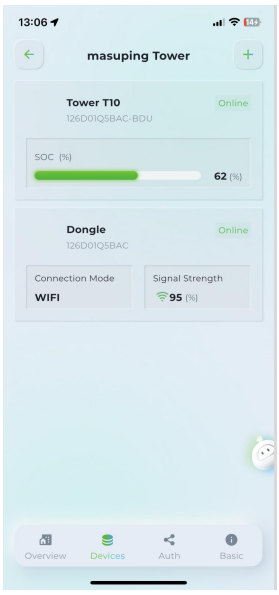

By switching tabs to enter the real-time data information page, you can view the data information of energy storage devices.

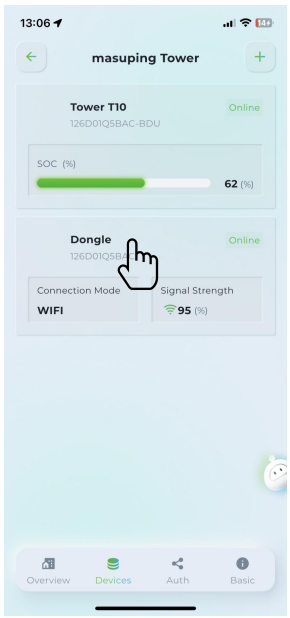

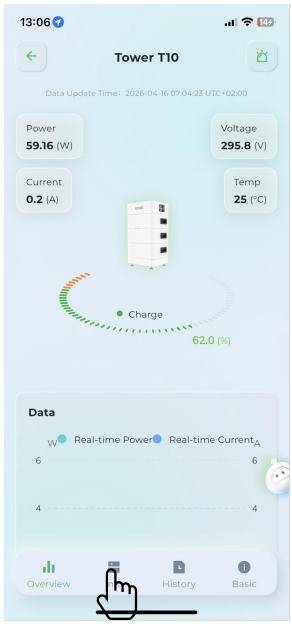


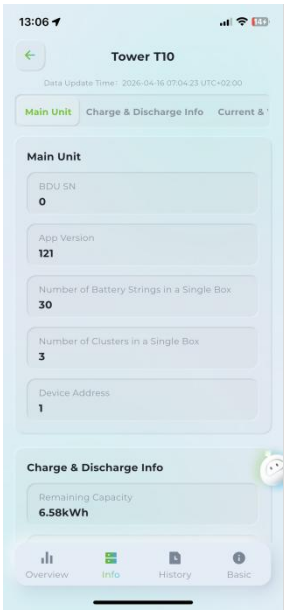


By switching tabs to enter the historical data page, you can view the historical data of energy storage devices.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

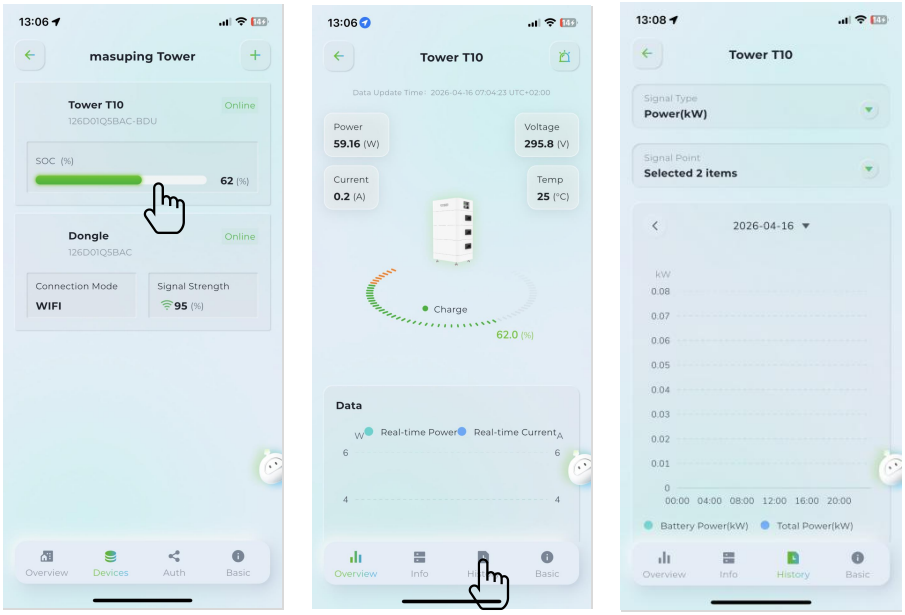

By switching tabs to enter the basic information page, you can view the basic information of the energy storage device.

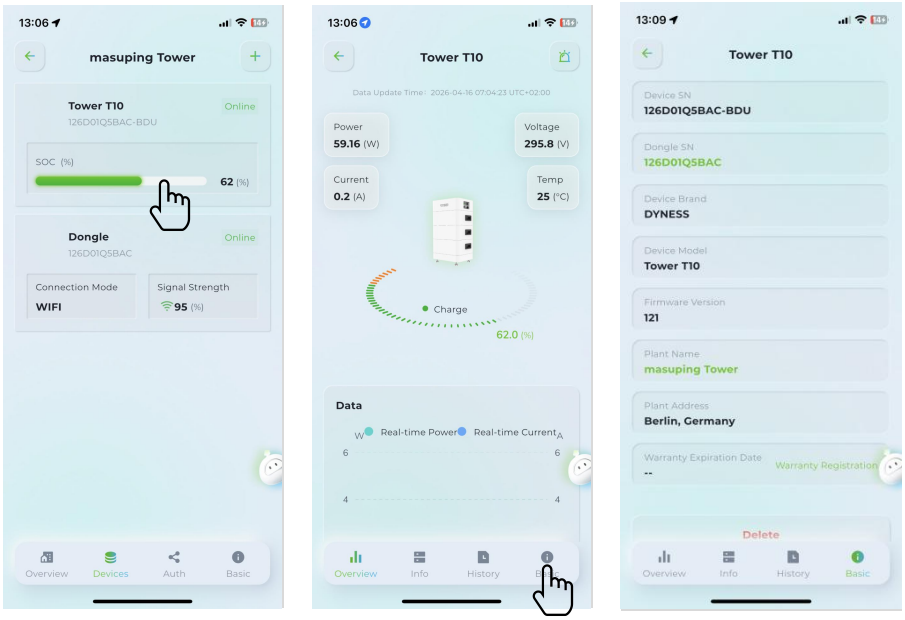

WiFi status indicators:

- If the yellow light flashing, it indicates that the distribution network has failed or not been distributed.
- If the yellow light remains on, it indicates successful network distribution and communication is currently being connected.
- If the green light remains on, it indicates successful network distribution and normal communication between BMS and WiFi.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

4 Maintenance

4.1 Troubleshooting

DANGER

The battery system is a high-voltage DC system. Ensure that the installation area of the STACK314is stable and reliable.
Please confirm that the battery system is switched off before connecting.
Electric shock and damage to the inverter may be caused if the battery is connected to the inverter directly without being powered off.
Otherwise, the system cannot operate properly. The voltage of the battery is too high, please pay attention to self-protection during measurement.

No.	Problem	Possible Reason	Solution
1	Pressing the "WAKE" button does not turn on the device, and the “D” light remains off.	The BDU DC breaker is not switched on.	Switch the BDU DC breaker on.
		The ON/OFF switch of the BDU is not switched on.	Switch the ON/OFF switch on.
		The battery voltage is severely low (<100V) or damaged.	Contact the battery manufacturer for further inspection.
2	Pressing the "WAKE" button turn on the device, the “D” light will turn on, but the display status of the light is yellow or red.	Improper placement of batteries and BDU during installation, resulting in misalignment of blind insertion pins.	Check the blind insertion pin and reset the misplaced blind insertion pin.
		Battery system protection.	Charge the battery to leave protection mode，or contact the battery manufacturer for further inspection.
3	The battery has no voltage output.	Battery changes into over-discharged	Charge the battery to leave protection mode.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

		protection.	
		Communication failure with inverter.	Check if the connection of the communication cable and PIN definition are correct.
		Inverter has an error.	Check for inverter errors and restore the inverter.
4	Battery shutdown	BDU DC circuit breaker open circuit.	Switch the BDU DC breaker on.
		Battery changes into over-discharged protection.	**Charge the battery to leave protection mode.**
		Battery is in sleep mode.	Press and hold the WAKE button for approx. 15s.
		The battery system has not undergone full charge calibration for a long time.	Perform a full charge calibration once.
5	SOC jump during battery charging and discharging process.	Inconsistent SOC of battery module.	The system performs 10 ~ 50 full charge balancing cycles (depending on the SOC difference of the module, the number of full charge balancing will vary)； or fully charge each battery module separately with BDU and DC power supply.
		Differences in battery cell consistency or damage.	Contact the battery manufacturer for further inspection.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


4.2 Replacement of Main Components

Replacing the Battery Controller (BDU)


WARNING

Turn off the entire battery system. Ensure that the negative and positive terminals are de-energized.

1. Turn the POWER ON knob to OFF,battery shutdown

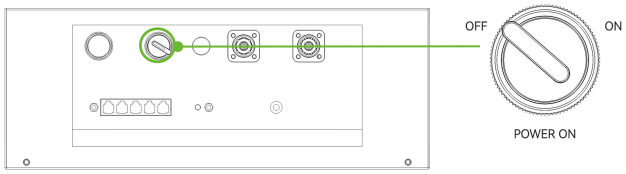

2. Switch the BDU DC BREAKER to OFF position.

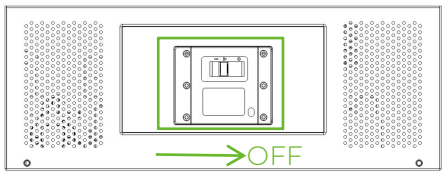

- Disconnect the connecting cable.
- Remove the four screws on the BDU and remove the BDU from the system.

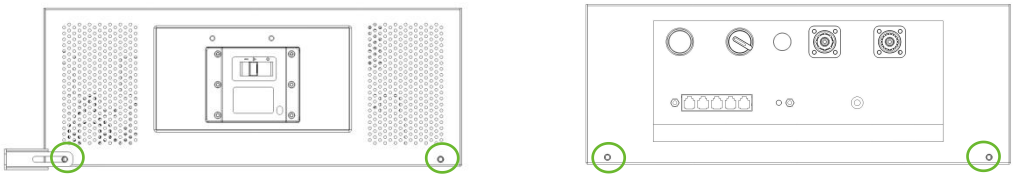


Figure 4-1 BDU right connector

- Exchange BDU,Then fix it with four screws.
- After replacing the new BDU, the battery self-test needs to be performed again (Refer to P19 Table 3-2 Battery system self-test).

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

4.3 Battery Maintenance

DANGER

Battery maintenance should only be carried out by professional and authorized persons.

Turn off the battery system first carrying out maintenance.

Voltage check:

[Periodical maintenance] Check the voltage of the battery system with the monitoring software. Check whether the system voltage is normal. For example: Check whether the single cell voltage is out of range.

Voltage check:

[Periodical maintenance] Check the SOC of the battery system with the monitoring software. Check whether the SOC of the batteries is normal.

Cable check:

[Periodical maintenance] Visually inspect all cables of the battery system. Check whether the cables are broken, aging or loose.

Balancing:

[Periodical maintenance] The battery system will become unbalanced if it has not been charged fully for a long time. Solution: Perform balancing maintenance (fully charge) every 10~12 month. Generally this maintenance progress needs to be completed when external devices such as the monitoring software and battery and inverter have proper communication.

Output relay check:

[Periodical maintenance] Under low load (low current), check the output relay OFF and ON condition; listen if the relay clicks, which means that it switches off and on normally.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

5 Storage

For long-term storage (more than 3 months), the battery cells should be stored within the temperature range of 5 to 45°C, relative humidity <65% and non-corrosive gases.
The battery module should be stored within the temperature range of 5 to 45°C, dry, clean and well ventilated environment. The battery should be charged to 50 - 55% SOC before storage.
We recommend activating the battery system (discharge and charge) every 10~12 months.
Corresponding to the battery system that has been installed and used normally, it is necessary to regularly fully charge the battery to calibrate the SOC. It is recommended to fully charge and calibrate at least once every 2 weeks.

CAUTION

The lifespan of the battery will be greatly reduced if you do not follow above instructions to store the battery for a long term.

6 Shipment


The battery module is pre-charged to 50% SOC or according to customer requirements before shipment. The remaining capacity of battery cells is determined by the storage time and condition after shipment.
The battery modules meet UN38.3 certificate standard.
In particular, special rules for the carriage of goods on the road and the current dangerous goods law, specifically ADR (European Convention on the International Carriage of Dangerous Goods by Road), as amended, must be observed.

© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn

Annex 1 STACK314 Expansion Pack Usage Guide

The difference between the base and how to use it

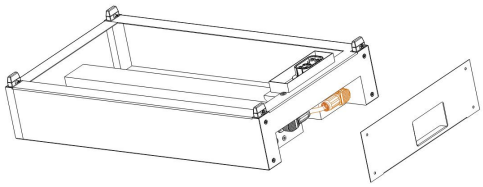

Standard Base

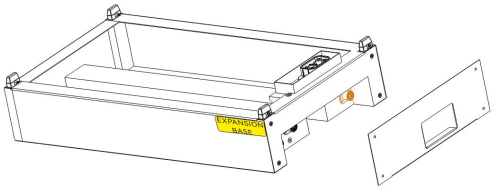

Standard Base

1. Single-column use



SBD

Standard Base


CAUTION

When using a single cluster, the base needs to use a standard base, and the expansion base cannot be used.

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn


2. Two columns for expansion use

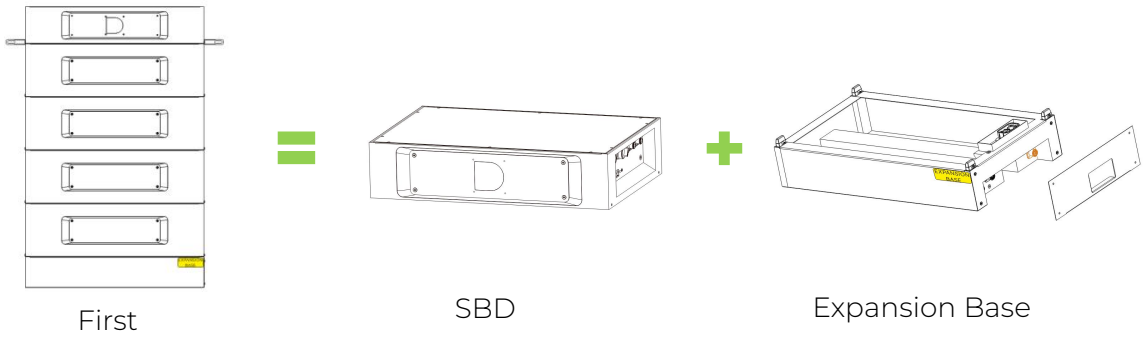



> **CAUTION**
>
> When using the expansion, the standard base needs to be converted into an expansion base. When using the expansion, the standard base cannot be used in any column.

3. The original system standard base needs to be modified to an expansion base

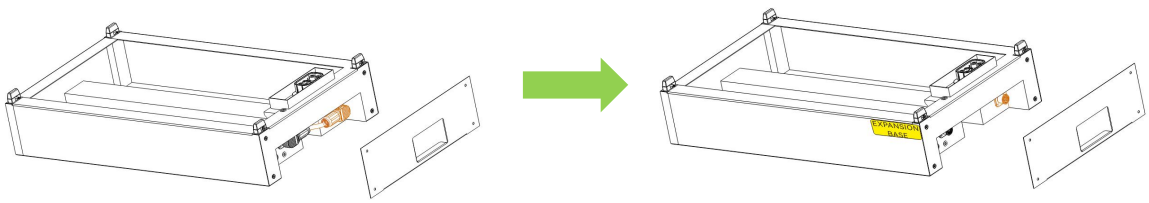


© Dyness reserves the copyright of this document.


VIỆT NAM SOLAR
vietnamsolar.vn

3.1 Remove the original base panel


Remove the four bolts that are fixed by the panel and remove the panel.

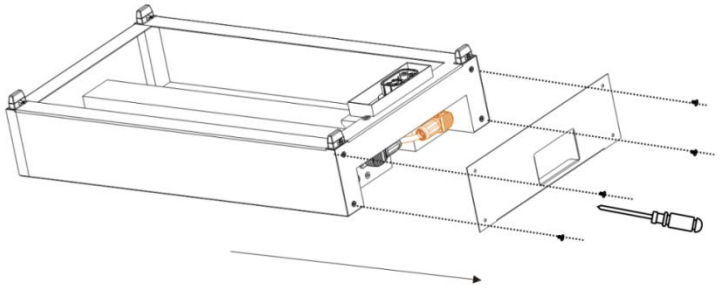


Remove the Series line from the Standard Base.

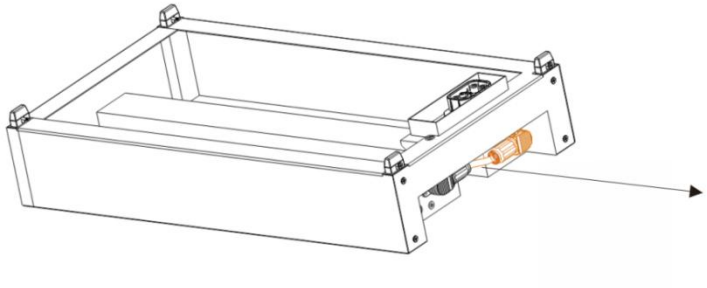

Remove the communication socket from the Standard Base.

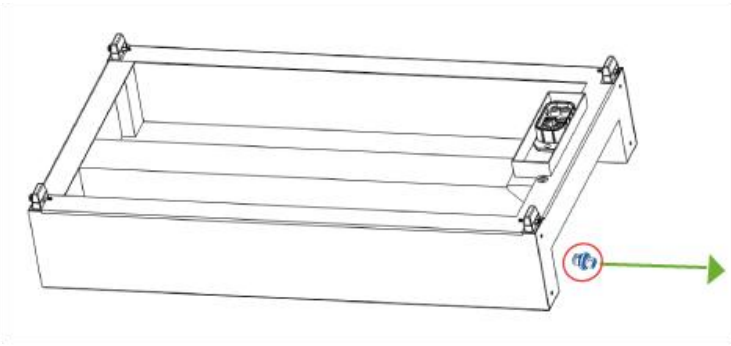

3.2 After the base modification is completed, a label needs to be attached

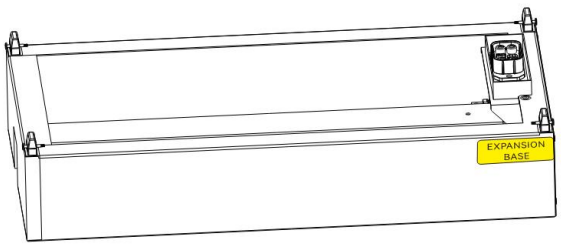

© Dyness reserves the copyright of this document.

VIỆT NAM SOLAR
vietnamsolar.vn

EU Declaration of Conformity

within the scope of the EU directives

- Radio Equipment Directive 2014/53/EU (22.5.2014 L 153/62) (RED)
- Restriction of the use of certain hazardous substances 2011/65/EU (L174/88, June 8, 2011) and 2015/863/EU (L 137/10,March 31, 2015) (ROHS)

Dyness Digital Energy Technology Co., LTD confirms herewith that the products described in this document are in compliance with the fundamental redquirements and other relevant provisions of the aforementioned directives. More information con the availability of the entire declaration of conformity can befound at https://dyness.com/declarations-of-conformity

Ratings	25.6-1000VDC, 30-300A
Frequency Range	2400MHz-2483.5MHz
Network Interface	802.11b/g/n, BLE 5.

© Dyness reserves the copyright of this document.

Dyness Digital Energy Technology Co., Ltd.

Email: service@dyness-tech.com

Company Address: 7th–8th Floors, Building 3 No. 58 Nanhu Road
Chengnan Subdistrict, Wuzhong District Suzhou, China

Website